

# CITY OF MARLBOROUGH MEETING POSTING

Meeting Name: City Council Public Services Committee

Date: August 18, 2015

Time: 6:45 PM

Location: City Council Chamber, 2<sup>nd</sup> Floor, City Hall, 140 Main Street

Agenda Items to be addressed:

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH  
2015 AUG 11 P 12:03

07-27-2015 – **Order No. 15-1006284**: Application for Livery License, Jose Heredia, d/b/a Alex Transportation, 110 Boston Post Road East.

- REFER TO PUBLIC SERVICES COMMITTEE

07-13-2015 – **Order No. 15-1006263A**: Petition of National Grid to install 3" conduit and install new #2 AL cable throughout Miles Standish residential development along the route of the existing cable due to numerous cable failures.

- REFER TO PUBLIC SERVICES COMMITTEE

- PUBLIC HEARING: JULY 27, 2015

07-13-2015 – **Order No. 15-1006264A**: Petition of Eversource Energy to install 1200' of 6" IP plastic gas main as a system improvement on Ames Street from Nickerson Road running Northwesterly to Reilly Way.

- REFER TO PUBLIC SERVICES COMMITTEE

- PUBLIC HEARING: JULY 27, 2015

06-01-2015 – **Order No. 15-1006237A**: Petition of Eversource to install 160' of 2" IP plastic gas main as a system improvement to 7 Corey Road.

- REFER TO PUBLIC SERVICES COMMITTEE

- PUBLIC HEARING: JUNE 15, 2015

THE LISTING OF TOPICS THAT THE CHAIR REASONABLY ANTICIPATES WILL BE DISCUSSED AT THE MEETING IS NOT INTENDED AS A GUARANTEE OF THE TOPICS THAT WILL HAVE BEEN DISCUSSED. NOT ALL TOPICS LISTED MAY IN FACT BE DISCUSSED, AND OTHER TOPICS NOT LISTED MAY ALSO BE BROUGHT UP FOR DISCUSSION TO THE EXTENT PERMITTED BY LAW.

**The public should take due notice that the Marlborough City Council may have a quorum in attendance due to Standing Committees of the City Council consisting of both voting and non-voting members. However, members attending this duly posted meeting are participating and deliberating only in conjunction with the business of the Standing Committee.**

**Electronic devices, including laptops, cell phones, pagers, and PDAs must be turned off or put in silent mode upon entering the City Council Chamber, and any person violating this rule shall be asked to leave the chamber. Express authorization to utilize such devices may be granted by the President for recordkeeping purposes.**



## IN CITY COUNCIL

Marlborough, Mass., JULY 27, 2015

### ORDERED:

That the Application for Livery License, Jose Heredia, d/b/a Alex Transportation, 110 Boston Post Rd. East, be and is herewith refer to **PUBLIC SERVICES COMMITTEE.**

ADOPTED

ORDER NO. 15-1006284

PD  
7/9/15  
\$100 - ok

11



RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

**City of Marlborough, Massachusetts  
CITY CLERK DEPARTMENT**

2015 JUL -9 P 3:03

**Lisa M. Thomas  
City Clerk**

*PJO*


**CITY OF MARLBOROUGH  
TAXI AND/OR LIVERY SERVICE LICENSE APPLICATION**

I. TYPE OF LICENSE: \_\_\_\_\_ TAXI  \_\_\_\_\_ LIVERY

2. APPLICANT'S (LICENSEE) INFORMATION:

- A. Name: JOSE R. HEREDIA
- B. Address: 110 BOSTON POST RD, Marlborough MA 01752
- C. Telephone Number: 781 492 5068
- D. Business Name: ALEX TRANSPORTATION
- E. Business Address: 110 BOSTON POST RD, Marlborough MA 01752
- F. Business Number: 781 492 5068

3. NUMBER OF VEHICLES: 1

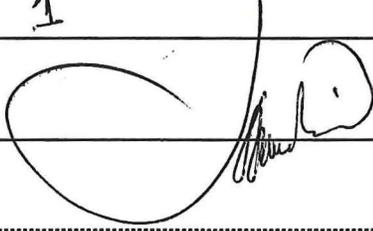APPLICANT'S SIGNATURE 

**CITY OF MARLBOROUGH  
TAXI/LIVERY LICENSE**

is hereby granted a Taxi/Livery License as approved by the City Council of the City of Marlborough on . In accordance with the Code of the City of Marlborough, Chapter 568, this License shall expire two (2) years from the date of issue. Application for renewal of said License shall be made to the City Council through the Office of the City Clerk.

EXPIRATION DATE: \_\_\_\_\_

A TRUE COPY  
ATTEST:  
City Clerk



# IN CITY COUNCIL

Marlborough, Mass., JULY 13, 2015

## ORDERED:

That there being no objection thereto set **MONDAY, JULY 27, 2015** as date for a **PUBLIC HEARING** On the Petition of NGrid to install 3" conduit and install new #2 AL cable throughout Miles Standish residential development along the route of the existing cable due to numerous cable failures, be and is herewith refer to **PUBLIC SERVICES COMMITTEE.**

ADOPTED

ORDER NO. 15-1006263



**City of Marlborough, Massachusetts  
CITY CLERK DEPARTMENT**

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 JUL 14 P 12:46

**Lisa M. Thomas  
City Clerk**

**CITY OF MARLBOROUGH  
OFFICE OF THE CITY CLERK  
NOTICE OF PUBLIC HEARING**

Notice is hereby given that the City Council of the City of Marlborough will hold a **PUBLIC HEARING** in City Council Chambers, City Hall on **Monday, July 27, 2015 at 8:00 p.m.** on the Petition from National Grid to install 3" conduit and install new #2 AL cable throughout Miles Standish residential development along the route of the existing cable due to numerous cable failures.

Per Order of City Council  
15-1006263

**PETITION FOR MANHOLE AND DUCT LOCATIONS**

*City Clerks Copy*

*12*

June 3, 2015 RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 JUN 15 P 1:49

To the City Council  
of the City of Marlborough, Massachusetts

**MASSACHUSETTS ELECTRIC COMPANY** requests permission to locate manholes, wires, and ducts, including the necessary sustaining and protecting fixtures, along and across the following public way:

*Pub Serv  
7/27/15*

**Miles Standish residential development**

**NGRID request due to numerous cable failures, will be installing 3" conduit and install new #2 AL cable throughout the Miles Standish residential development along the route of the existing cable.**

Wherefore it prays that after due notice and hearing as provided by law, it be granted a location for and permission to install and maintain manholes, ducts and wires, together with such sustaining and protecting fixtures as it may find necessary, said manholes and ducts to be installed substantially in accordance with the plan filed herewith marked--

**MASSACHUSETTS ELECTRIC COMPANY**

Plan No. 16508872 Dated: 06/01/2015

**MASSACHUSETTS ELECTRIC COMPANY**

By: *Eric Widman*  
Manager of Distribution Design *EW*

**ORDER FOR MANHOLE AND DUCT LOCATIONS**

June 3, 2015

By the City Council  
of the City of Marlborough, Massachusetts

Notice having been given and a public hearing held, as provided by law,  
IT IS HEREBY ORDERED:

that **MASSACHUSETTS ELECTRIC COMPANY** be and it is hereby granted permission to excavate the public highways and to run and maintain underground electric conduits, together with such sustaining and protecting fixtures as said Company may deem necessary, in the public way or ways hereinafter referred to, as requested in petition of said Company dated the **3rd day of June, 2015**

All construction under this order shall be in accordance with the following conditions:--

Manholes and ducts shall be set substantially at the points indicated upon the plan marked--

**MASSACHUSETTS ELECTRIC COMPANY**

Plan No. **16508872**

Dated: **06/01/2015**

The following are the public ways or parts of ways along which the manholes/ducts above referred to may be installed, and the number of manholes/ducts which may be installed thereon under this order:--

**Miles Standish residential development**

**NGRID request due to numerous cable failures, will be installing 3" conduit and install new #2 AL cable throughtout the Miles Standish residential development along the route of the existing cable.**

I hereby certify that the foregoing order was adopted at a meeting of the City Council of the City of Marlborough, Massachusetts held on the \_\_\_\_\_ day of \_\_\_\_\_ 2015

\_\_\_\_\_  
Clerk of Council

Received and entered in the records of location orders of the City of Marlborough, Massachusetts

Book: \_\_\_\_\_ Page: \_\_\_\_\_

\_\_\_\_\_  
City Clerk

We hereby certify that on \_\_\_\_\_, 20\_\_\_\_, at \_\_\_\_\_ o'clock, \_\_\_\_\_ M

at \_\_\_\_\_ a public hearing was held on the petition of

**MASSACHUSETTS ELECTRIC COMPANY** for permission to construct the underground electric conduits described in the order herewith recorded, and that I mailed at least seven days before said hearing a written notice of the time and place of said hearing to each of the owners of real estate (as determined by the last preceding assessment for taxation) along the ways or parts of ways upon which the Company is permitted to construct the underground electric conduits under said order. And that thereupon said order was duly adopted.

Council of the City of

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
Marlborough, Massachusetts

**CERTIFICATE**

I hereby certify that the foregoing is a true copy of a location order and certificate of hearing with notice adopted by the City Council of the City of Marlborough, Massachusetts, on the \_\_\_\_\_ day of \_\_\_\_\_ 2015 and recorded with the records of location orders of said City, Book \_\_\_\_\_, Page \_\_\_\_\_.

This certified copy is made under the provisions of Chapter 166 of General Laws and any additions thereto or amendments thereof.

Attest: \_\_\_\_\_  
City Clerk

**Pole & UG Petition/Permit Request Form**

City Marlborough, MA WR # 16508872  
Town of \_\_\_\_\_  
(circle one)

Install \_\_\_\_\_ SO  
(quantity) (circle one) JO Poles on \_\_\_\_\_  
(street name)

Remove \_\_\_\_\_ SO  
(quantity) (circle one) JO Poles on \_\_\_\_\_  
(street name)

Relocate \_\_\_\_\_ SO  
(quantity) (circle one) JO Poles on \_\_\_\_\_  
(street name)

Beginning at a point approximately \_\_\_\_\_ feet \_\_\_\_\_ of the centerline  
(distance) (compass heading)

of the intersection of \_\_\_\_\_  
(street name)

and continuing approximately \_\_\_\_\_ feet in a \_\_\_\_\_ direction.  
(distance) (compass heading)

Install underground facilities: Richard Rd, Lambert Cir, Crosby Rd, Denoncourt St, Miles Standish  
Dr, Boyd Cir, Girard St, Turmaine St, Fontaine St, Simpson Rd,  
Naugler Ave, Wood Rd, Gordon Rd, Dean Rd, Barnard Rd,  
Street(s) \_\_\_\_\_ Evergreen Ln, McCabe Dr, Dawes St, Hardy Rd

Description of Work Due to numerous cable failures, National Grid will be installing  
3" conduit and installing new #2 Al cable throughout the Miles Standish  
residential development along the route of the existing cable.

Please see drawing 16508872, 19169180, 19181886, 19154754.

ENGINEER Patrick Scanlon

DATE 6/1/2015

nationalgrid

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 JUN 15 P 1:49

June 3, 2015

City of Marlborough  
City Clerks Office  
140 Main Street  
Marlborough, MA 01752

To Whom It May Concern:

Enclosed please find a petition of NATIONAL GRID covering the installation of underground facilities.

If you have any questions regarding this permit please contact:

Patrick Scanlon 781-423-3062

If this petition meets with your approval, please return an executed copy to:

National Grid Contact: Angela Birch; 280 Melrose Street; Providence, RI

Very truly yours,


*Eric Widman* *AW*

Eric Widman, Engineering  
Supervisor, Distribution Design

Enclosures

MILES STANDISH URD  
MARLBOROUGH, MA  
WR#16508872

STREET MAP  
LOCUS OF PROJECT

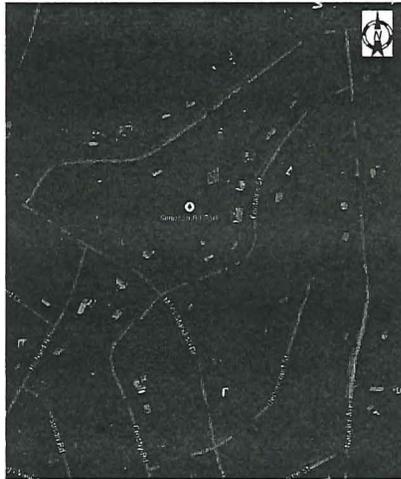


SHEET NUMBER	SHEET NAME
	COVER SHEET
	MILES STANDISH INDEX MAP
1	CONDUIT PLAN- MILES STANDISH DRIVE
2	CONDUIT PLAN- MILES STANDISH DRIVE
3	CONDUIT PLAN- SIMPSON ROAD
4	CONDUIT PLAN- SIMPSON ROAD
5	CONDUIT PLAN- SIMPSON ROAD
6	CONDUIT PLAN- SIMPSON ROAD
7	CONDUIT PLAN- SIMPSON ROAD
8	CONDUIT PLAN- SIMPSON ROAD
9	CONDUIT PLAN- NAUGLER ROAD
10	CONDUIT PLAN- NAUGLER ROAD
11	CONDUIT PLAN- NAUGLER ROAD
12	CONDUIT PLAN- NAUGLER ROAD
13	CONDUIT PLAN- NAUGLER ROAD
14	CONDUIT PLAN- NAUGLER ROAD
15	CONDUIT PLAN- TURMAINE STREET
EXISTING OL	EXISTING ONE LINE DIAGRAM
PROPOSED OL	PROPOSED ONE LINE DIAGRAM
DETAILS	MILES STANDISH DETAILS SHEET

PROJECT DESCRIPTION:  
INSTALL APPROXIMATELY 11,000' OF CONDUIT ALONG MILES STANDISH DRIVE, SIMPSON RD, NAUGLER AVE, AND TURMAINE ST.

INSTALL SIX (6) HEAVY DUTY HAND HOLES

REPLACE APPROXIMATELY TWENTY-TWO (22) SECONDARY HAND HOLES.

PROPRIETARY NOTICE						 200 LEDGEWOOD PLACE SUITE 300 ROCKLAND, MA 02370 Tel: (781) 423-3062 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM DESIGN ENGINEER: PATRICK SCANLON	 MILES STANDISH URD - WR #16508872 MARLBOROUGH, MA								
THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (I) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.							0 INTIAL RELEASE REV DESCRIPTION		4/15/2015 DATE	JPP CADD	PS ENGINEER	PS APPROVED	SCALE: N.T.S.	DWG NO: 16508872	SHF: COVER

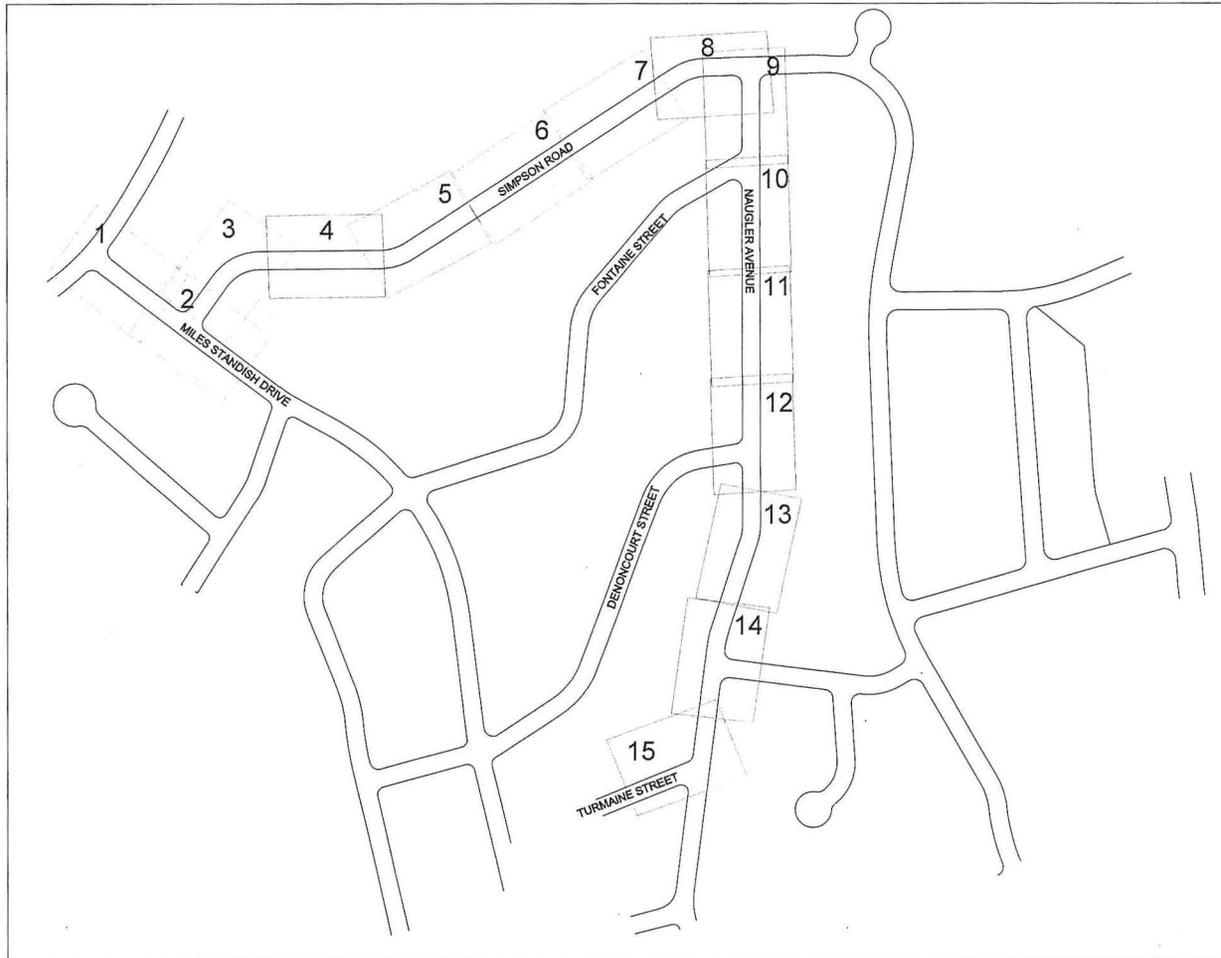

**CONSTRUCTION NOTES:**

1. ALL CONSTRUCTION IS TO BE DONE IN ACCORDANCE WITH NATIONAL GRID CONSTRUCTION STANDARDS.

**RESTORATION**

2. RESTORE AS SHOWN IN TRENCH DETAIL IN PAVED AREAS.

3. LOAM & SEED IN UNPAVED AREAS. RESTORE ALL AREAS TO EXISTING OR BETTER CONDITIONS.

**EXCAVATION**

4. ALL NECESSARY PERMITS TO TRENCH AND EXCAVATE, INCLUDING STREET PERMITS AND ENVIRONMENTAL PERMITS SHALL BE OBTAINED.

5. PRIOR TO EXCAVATION NECESSARY DIGSAFE PERMITS SHALL BE OBTAINED, FOR THE PURPOSE OF VERIFYING THE SUBSURFACE UTILITIES IN THE AREA.

6. ALL DIGGING MUST MAINTAIN AN 18" TOLERANCE ZONE FROM EXISTING UG CABLE. IF SUCH A ZONE CANNOT BE KEPT, THE SECTION OF CABLE SHALL BE DE-ENERGIZED BY NATIONAL GRID PERSONNEL PRIOR TO DIGGING.

7. EXCAVATION FOR AN ENTIRE RUN SHALL BE COMPLETED PRIOR TO CONDUIT INSTALLATION TO PRECLUDE ENCOUNTERING UNEXPECTED OBSTRUCTIONS. THE TRENCH SHALL BE EXCAVATED AND TRIMMED IN SUCH A WAY THAT BACKFILL IS NOT REQUIRED TO ESTABLISH THE PROPER LINE OF GRADE.

8. BACKFILL MATERIAL SHALL CONSIST OF SAND OR EARTH, OR A MIXTURE WHICH MAY CONTAIN ROCKS, PROVIDED THE ROCKS DO NOT EXCEED 2 INCHES IN ANY DIMENSION AND HAVE NO SHARP EDGES.

9. WARNING TAPE (STD ITEM UT8) SHALL BE INSTALLED 12-18 INCHES BELOW FINISHED GRADE AND DIRECTLY ABOVE ELECTRIC CONDUIT.

10. NATIONAL GRID SHALL BE NOTIFIED OF ALL ASBUILT CHANGES THAT MAY CONFLICT WITH THE DESIGN.

**DUCTBANK:**

11. PULLING TAPE TO BE INSTALLED IN ALL CONDUITS.

12. SPACERS SHALL BE PLACED AT 5 - 8 FOOT INTERVALS AND SHALL BE PLACED AT EACH COUPLING.

13. THE MINIMUM BURIAL DEPTH BETWEEN THE TOP OF THE COMPLETED CONDUIT, CONDUIT BANK OR DIRECT BURIED CABLE AND GRADE IS 30 INCHES.

14. CONDUIT BENEATH DRIVE-ABLE SURFACES SHALL BE ENCASED IN CONCRETE.

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETURN OF THE DOCUMENT ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETURN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS



200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370


TEL: (781) 433-3062

E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON





MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: N.T.S.	DWG NO: 16508872	SHT: INDEX MAP	REV: 0
---------------	------------------	----------------	--------

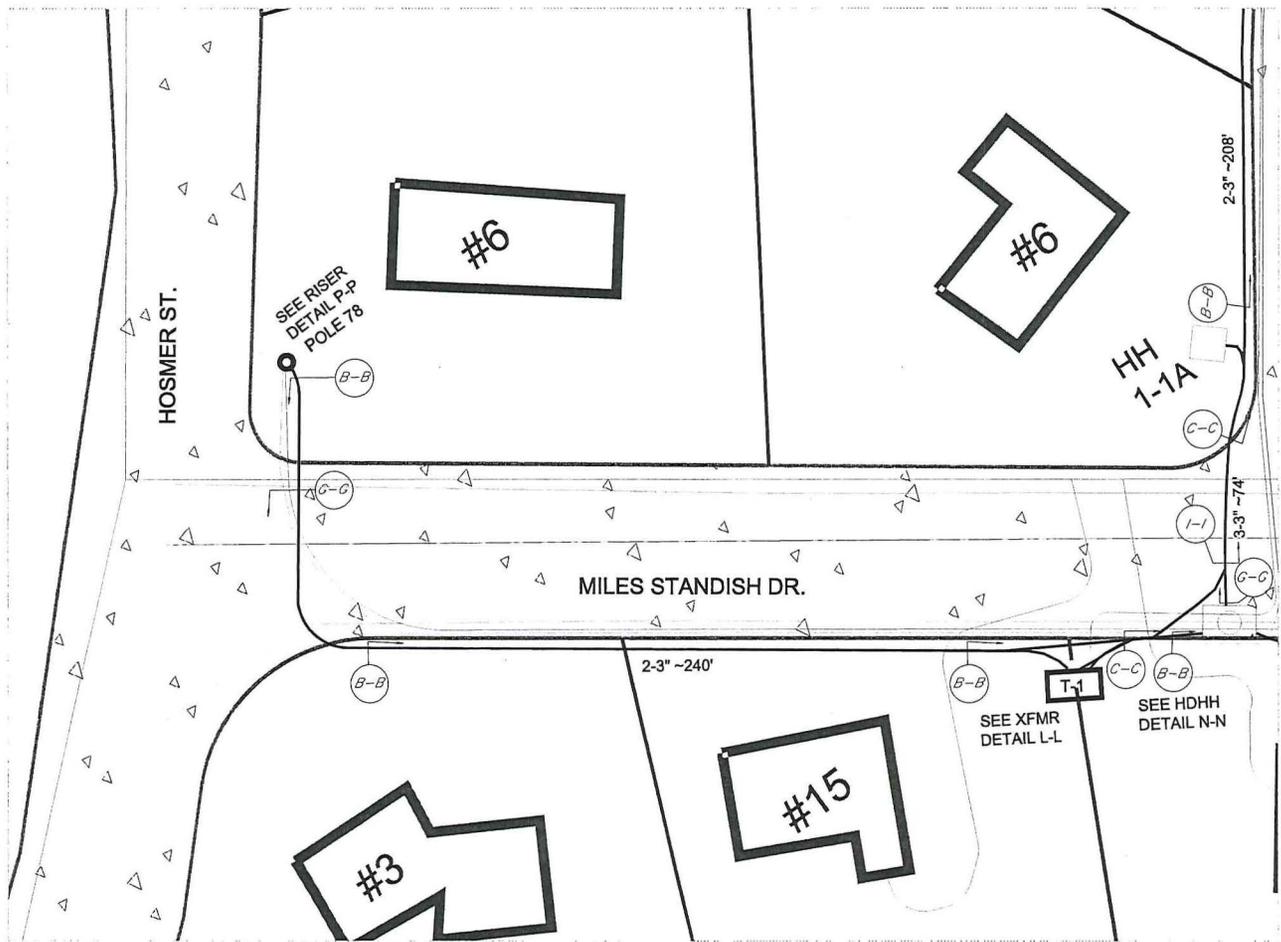

**LEGEND**


	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

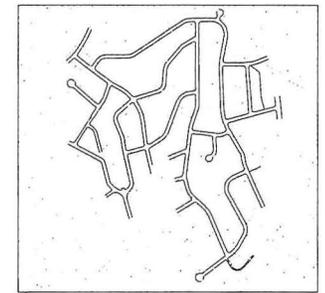

MATCH TO SHEET 02



<b>PROPRIETARY NOTICE</b>						<p><b>ControlPoint</b> TECHNOLOGIES</p> <p>200 LEDGEWOOD PLACE SUITE 300 ROCKLAND, MA 02370 Tel: (781) 423-3062 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM DESIGN ENGINEER: PATRICK SCANLON</p>	<p>MILES STANDISH URD - WR #16508872 MARLBOROUGH, MA</p> <p>SCALE: 1"-10'    DWG NO: 16508872    SHY: 01 OF 15    REV: 0</p>			
<p>THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT IS NOT TO USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.</p>										
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS					
REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED					



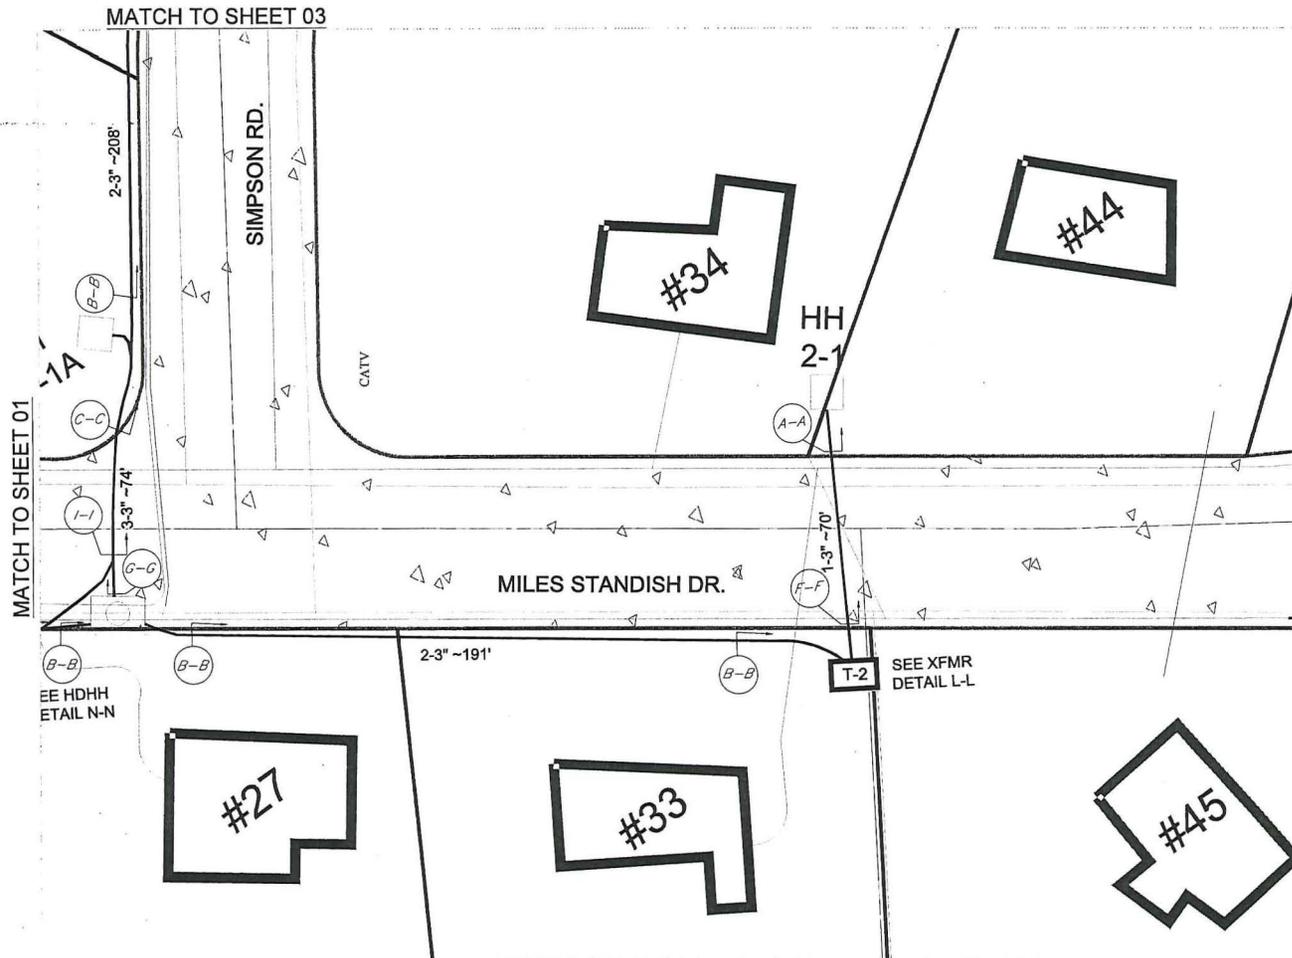

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

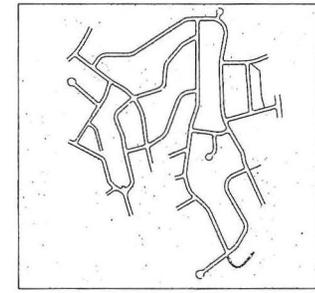

<b>PROPRIETARY NOTICE</b>					
<small>THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (S) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.</small>					
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS
REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED

**ControlPoint**  
TECHNOLOGIES


200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
TEL: (781) 423-3062

E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10' DWG NO: 16508872 SH: 02 OF 15 REV: 0

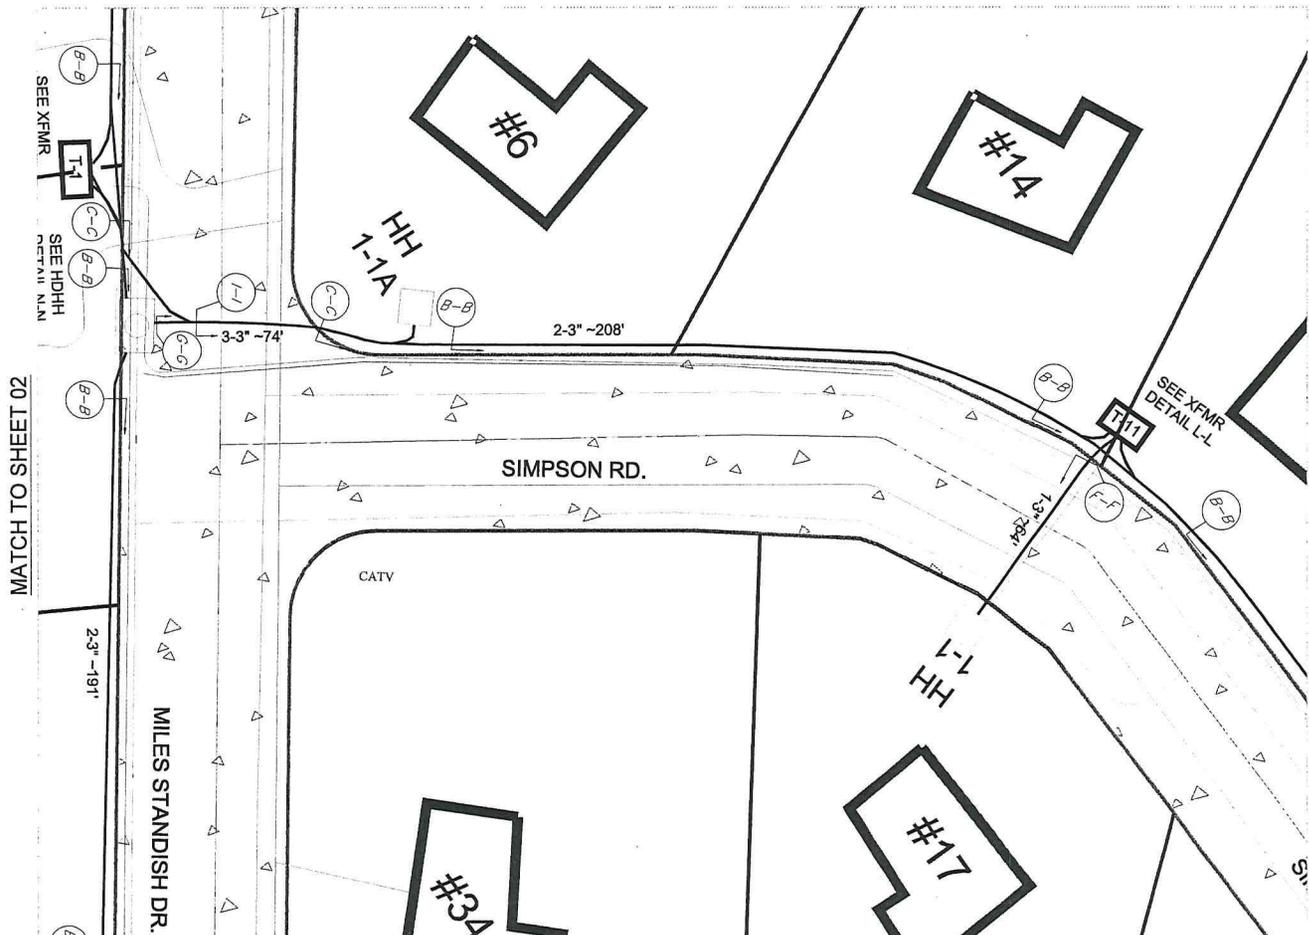

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

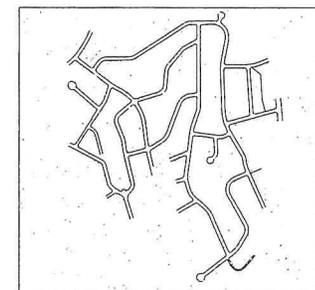

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEPTION AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (I) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL, TRADE SECRET INFORMATION THEREON, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL, TRADE SECRET INFORMATION THEREON, AND (II) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS


**ControlPoint**  
TECHNOLOGIES

200 LEDGEWOOD PLACE SUITE 900  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'  
DWG NO: 16508872  
SHT: 03 OF 15  
REV: 0

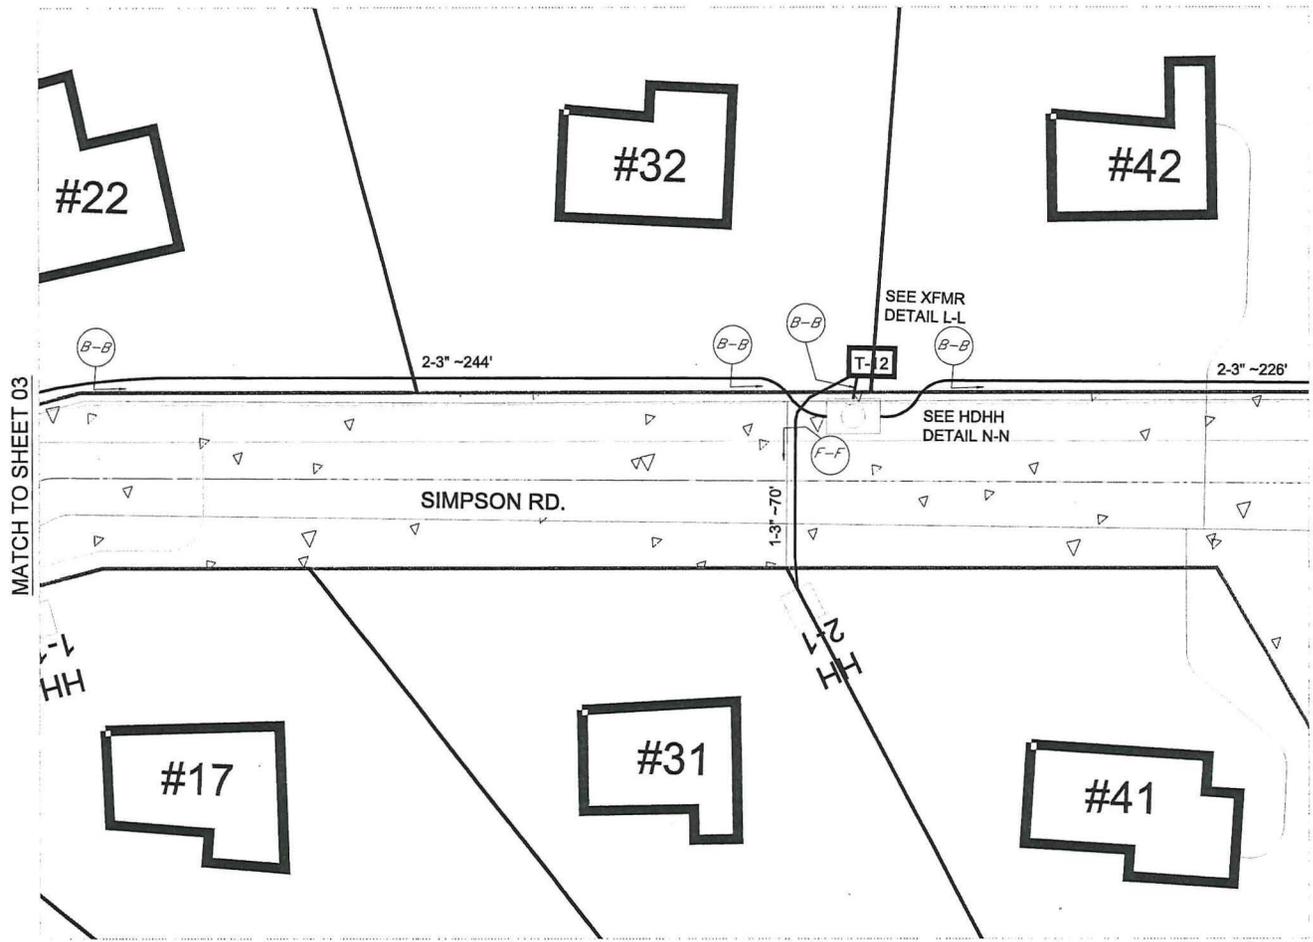

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

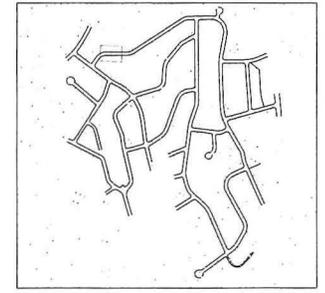

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY ACCEPTANCE AND RETENTION OF THIS DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (2) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS


**ControlPoint TECHNOLOGIES**

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'    DWG NO: 16508872    SHIT: 04 OF 15    REV: 0

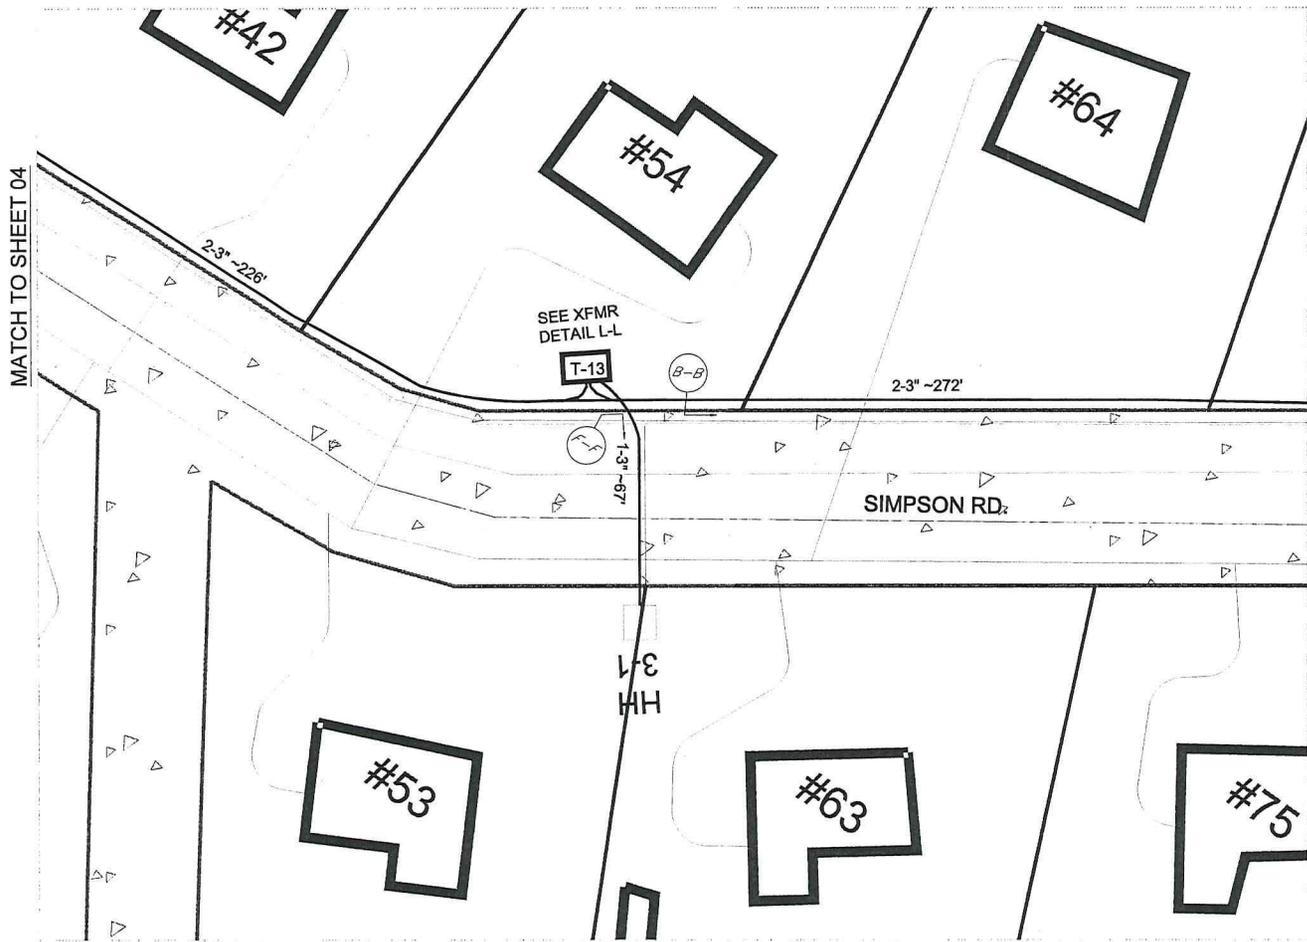

**LEGEND**

ASPHALT	ELECTRIC
HYDRANT	SEWER
TRANSFORMER	DRAIN
PROPOSED PULL BOX	WATER
EXISTING HEAVY DUTY HANDHOLE	GAS
PROPOSED HEAVY DUTY HANDHOLE	PROPOSED ELECTRIC CONDUIT
REPLACE SECONDARY HANDHOLE	

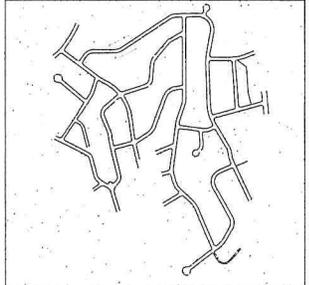

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEPTION AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL DERIVED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC., ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS


**ControlPoint TECHNOLOGIES**

200 LEDGEWOOD PLACE SUITE 300  
 ROCKLAND, MA 02370  
 Tel: (781) 423-3062  
 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
 DESIGN ENGINEER: PATRICK SCANLON



**nationalgrid**

MILES STANDISH URD - WR #16508872  
 MARLBOROUGH, MA

SCALE: 1"=10' DWG NO: 16508872 SH: 05 OF 15 REV: 0

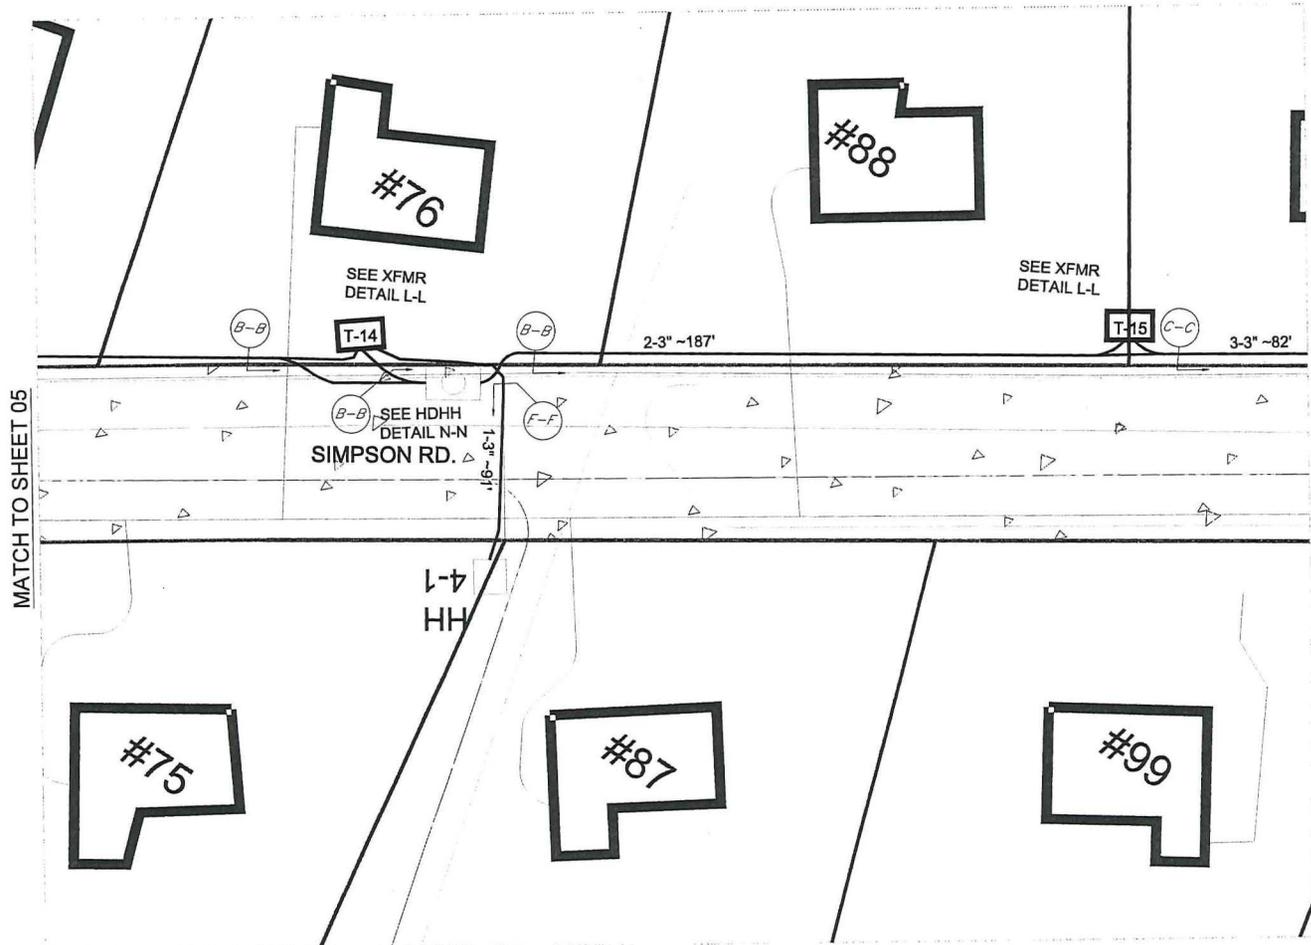

LEGEND	
	ASPHALT
	HYDRANT
	TRANSFORMER
	PROPOSED PULL BOX
	EXISTING HEAVY DUTY HANDHOLE
	PROPOSED HEAVY DUTY HANDHOLE
	REPLACE SECONDARY HANDHOLE
	ELECTRIC
	SEWER
	DRAIN
	WATER
	GAS
	PROPOSED ELECTRIC CONDUIT

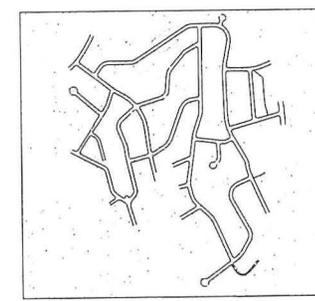

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THIS DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT IS NOT TO USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL, TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR ANY CONFIDENTIAL, TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIES THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

**ControlPoint**  
TECHNOLOGIES


200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062

E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON



**nationalgrid**

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'  
DWG NO: 16508872  
SHT: 06 OF 15  
REV: 0

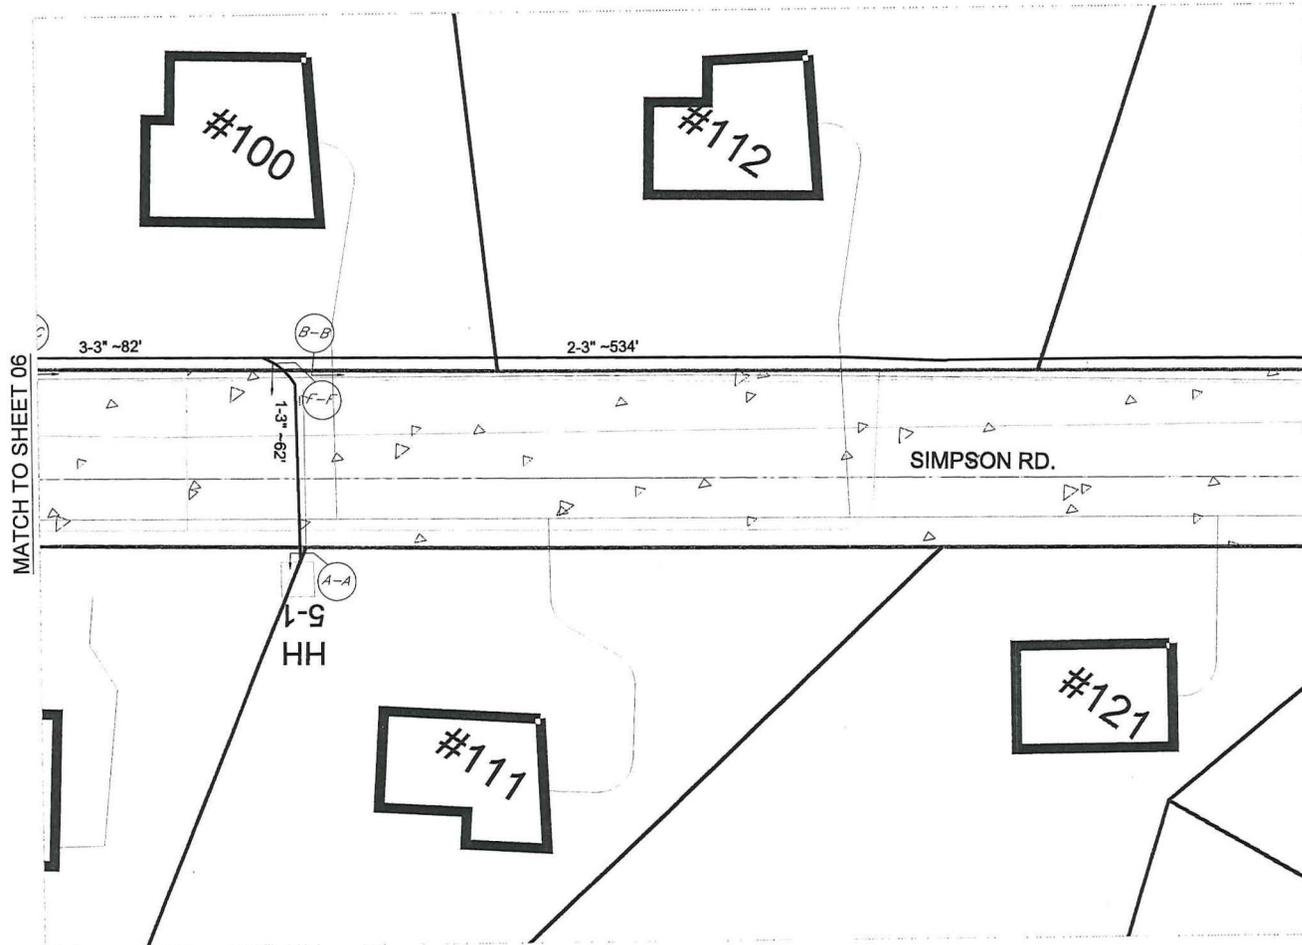

LEGEND	
	ASPHALT
	HYDRANT
	TRANSFORMER
	PROPOSED PULL BOX
	EXISTING HEAVY DUTY HANDHOLE
	PROPOSED HEAVY DUTY HANDHOLE
	REPLACE SECONDARY HANDHOLE
	ELECTRIC
	SEWER
	DRAIN
	WATER
	GAS
	PROPOSED ELECTRIC CONDUIT

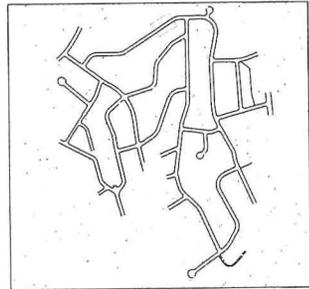

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER BY RECEIPT AND RETENTION OF THIS DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT IS NOT TO USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS BEYOND THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETURN THE DOCUMENT, OR UPON DEMAND RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC., ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

**ControlPoint**  
TECHNOLOGIES


200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062

E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10' DWG NO: 16508872 SHF: 07 OF 15 REV: 0

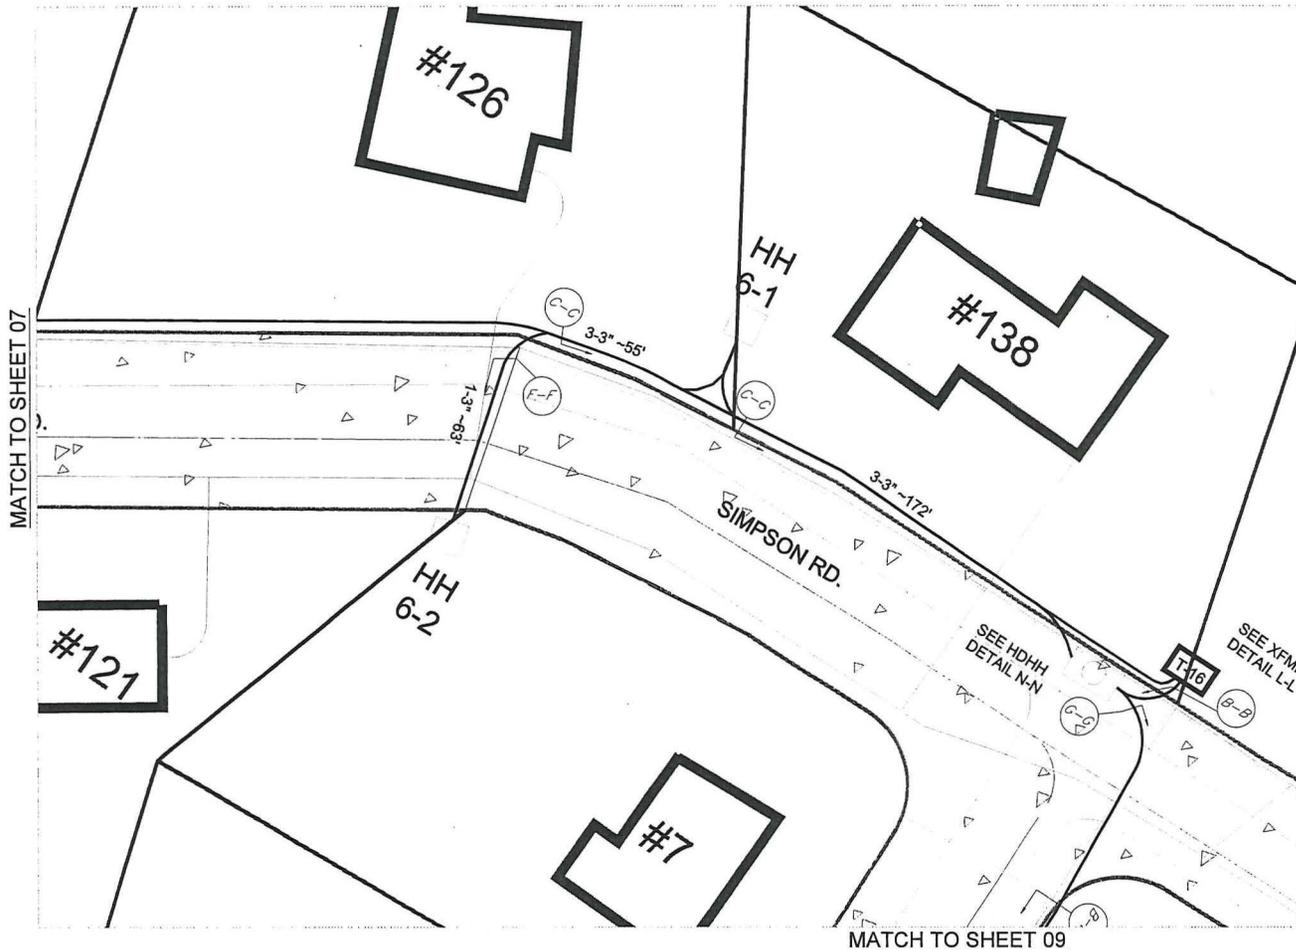

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

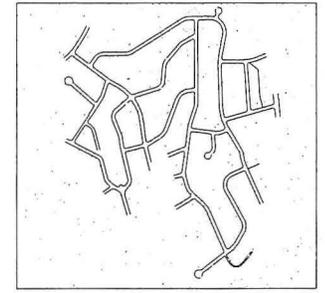

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEPTION AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (2) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS


**ControlPoint**  
TECHNOLOGIES

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WVR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10' DWG NO: 16508872 SHW: 08 OF 15 REV: 0

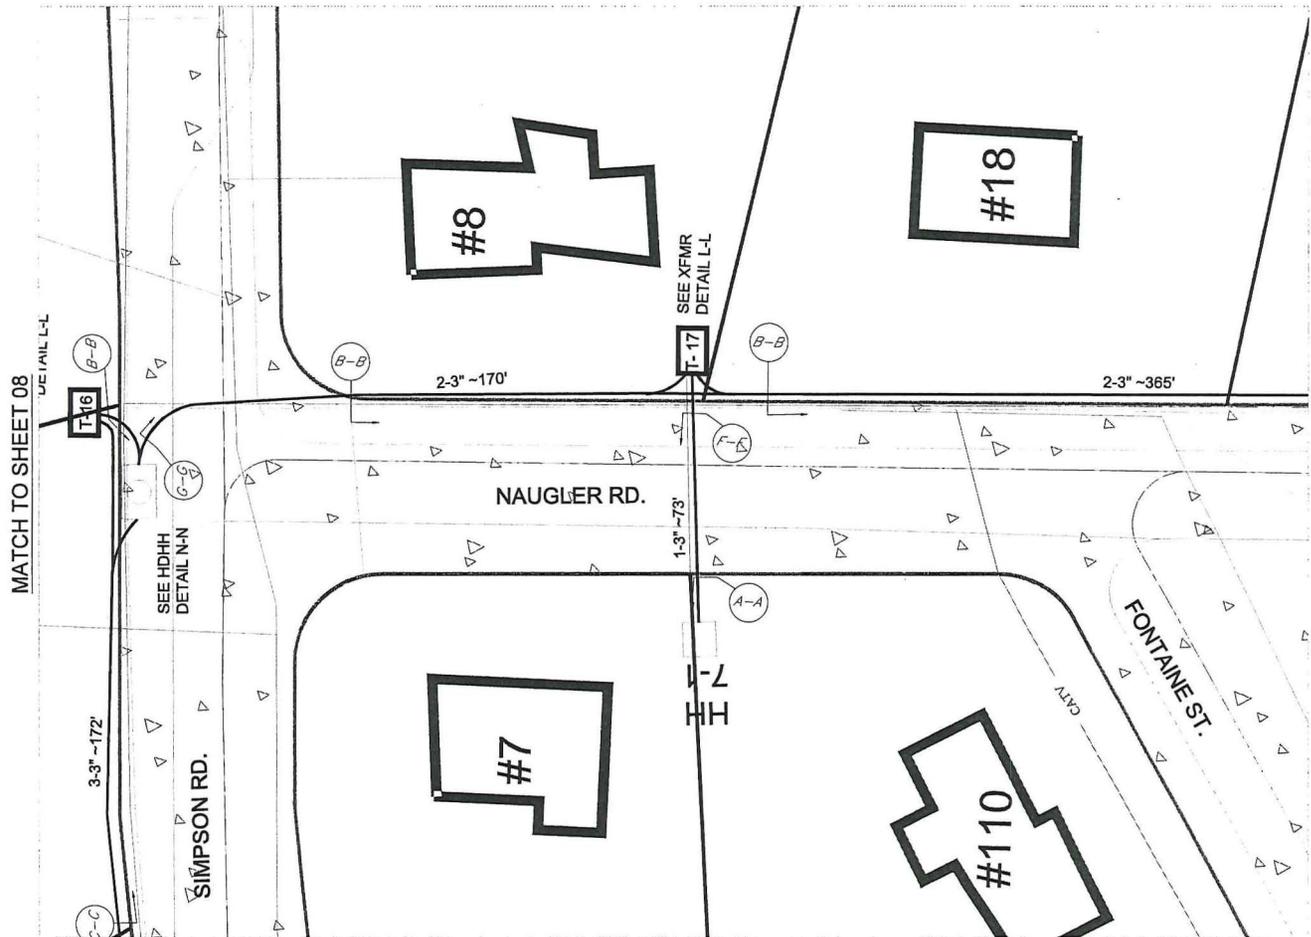

**LEGEND**

ASPHALT	ELECTRIC
HYDRANT	SEWER
TRANSFORMER	DRAIN
PROPOSED PULL BOX	WATER
EXISTING HEAVY DUTY HANDHOLE	GAS
PROPOSED HEAVY DUTY HANDHOLE	PROPOSED ELECTRIC CONDUIT
REPLACE SECONDARY HANDHOLE	

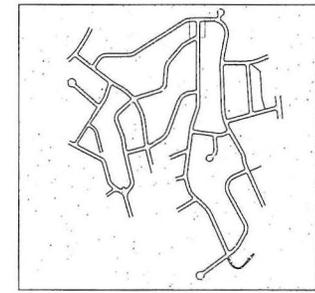

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIVING AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL AND TRADE SECRET INFORMATION THEREIN; OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL AND TRADE SECRET INFORMATION THEREIN; AND (2) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL, COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS




200 LEDGEWOOD PLACE SUITE 300  
 ROCKLAND, MA 02370  
 TEL: (781) 423-3062  
 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
 DESIGN ENGINEER: PATRICK SCANLON





MILES STANDISH URD - W/R #16508872  
 MARLBOROUGH, MA

SCALE: 1"=10'	DWG NO: 16508872	SHT: 09 OF 15	REV: 0
---------------	------------------	---------------	--------

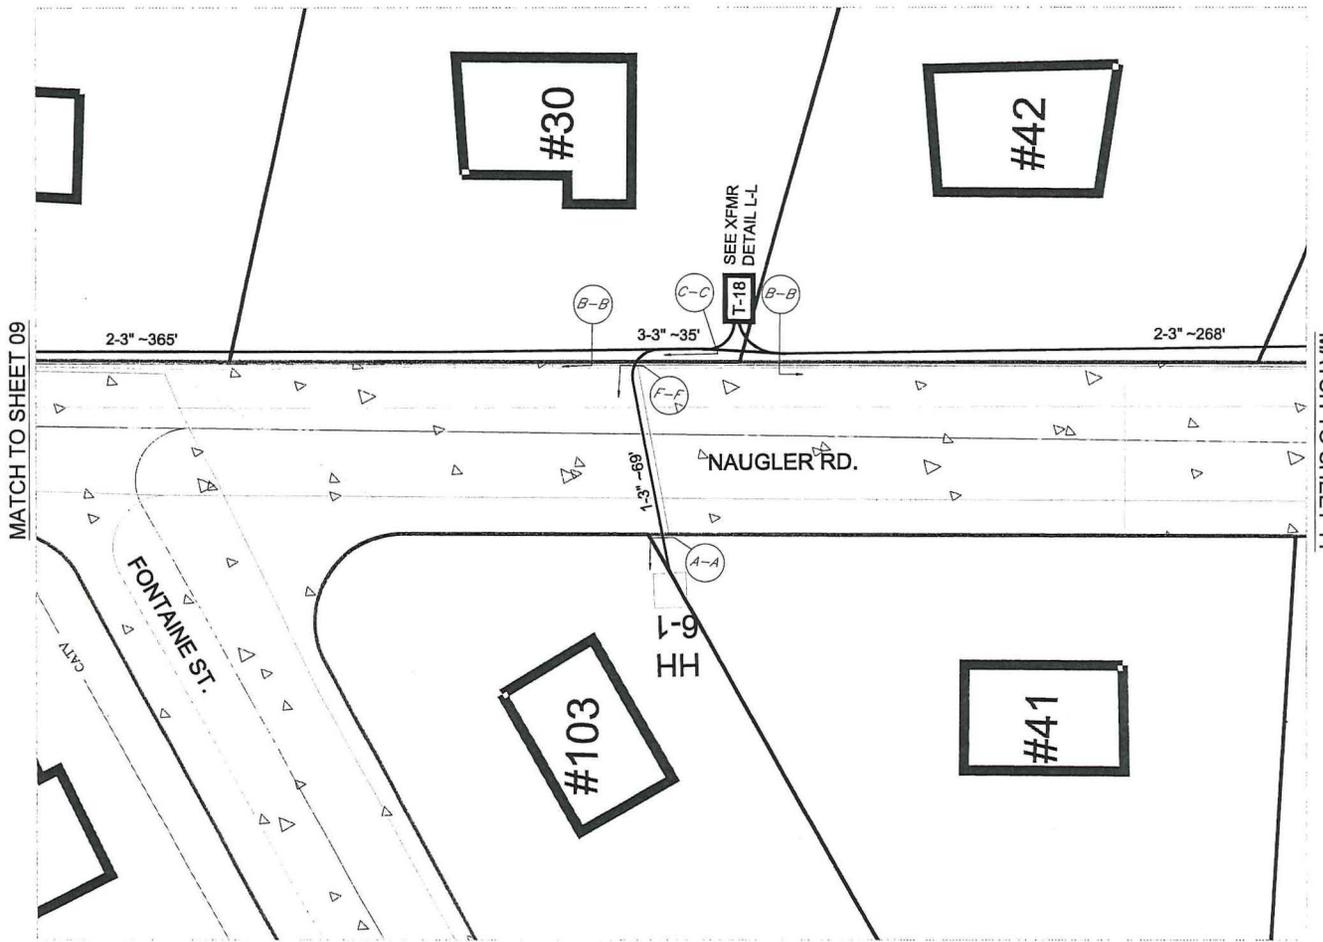

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

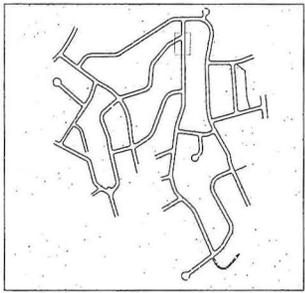

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT IS NOT TO USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL DERIVED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

**ControlPoint**  
TECHNOLOGIES


200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3052

E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'    DWG NO: 16508872    SHET: 10 OF 15    REV: 0

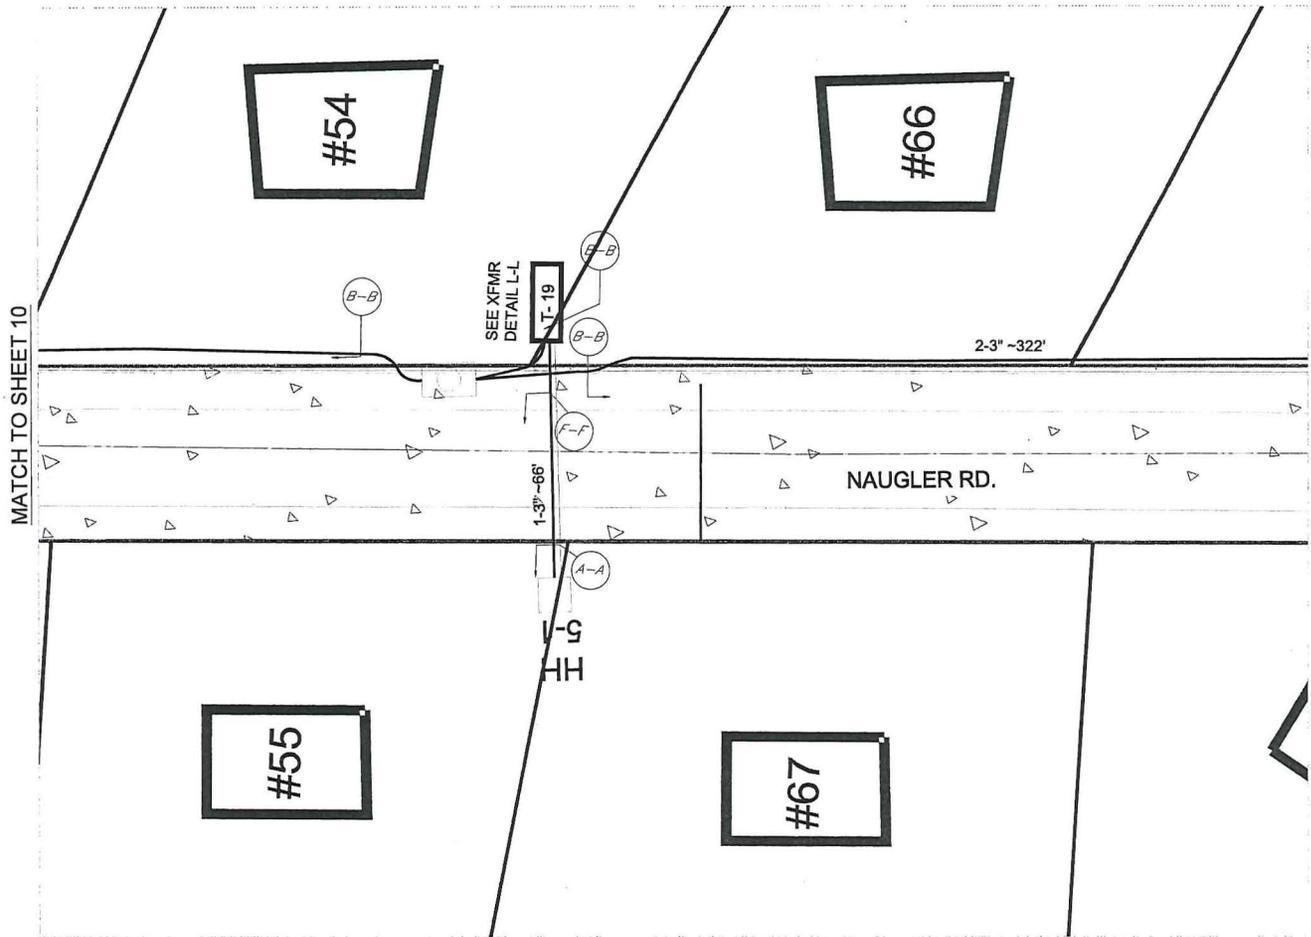

**LEGEND**

ASPHALT	ELECTRIC
HYDRANT	SEWER
TRANSFORMER	DRAIN
PROPOSED PULL BOX	WATER
EXISTING HEAVY DUTY HANDHOLE	GAS
PROPOSED HEAVY DUTY HANDHOLE	PROPOSED ELECTRIC CONDUIT
REPLACE SECONDARY HANDHOLE	

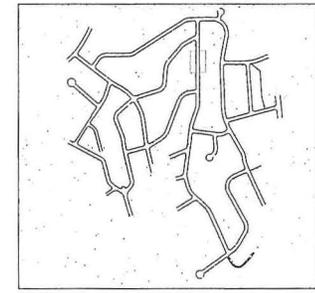

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, OR NOT COPY THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (2) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS





**ControlPoint TECHNOLOGIES**

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'    DWG NO: 16508872    SH: 11 OF 15    REV: 0

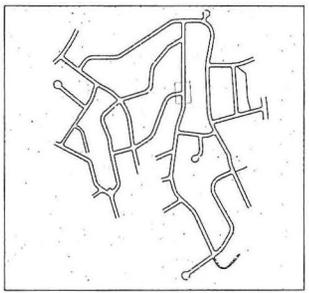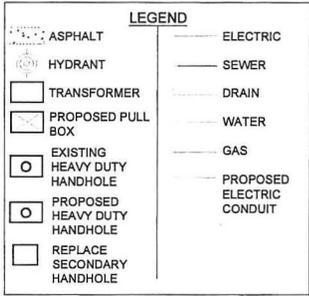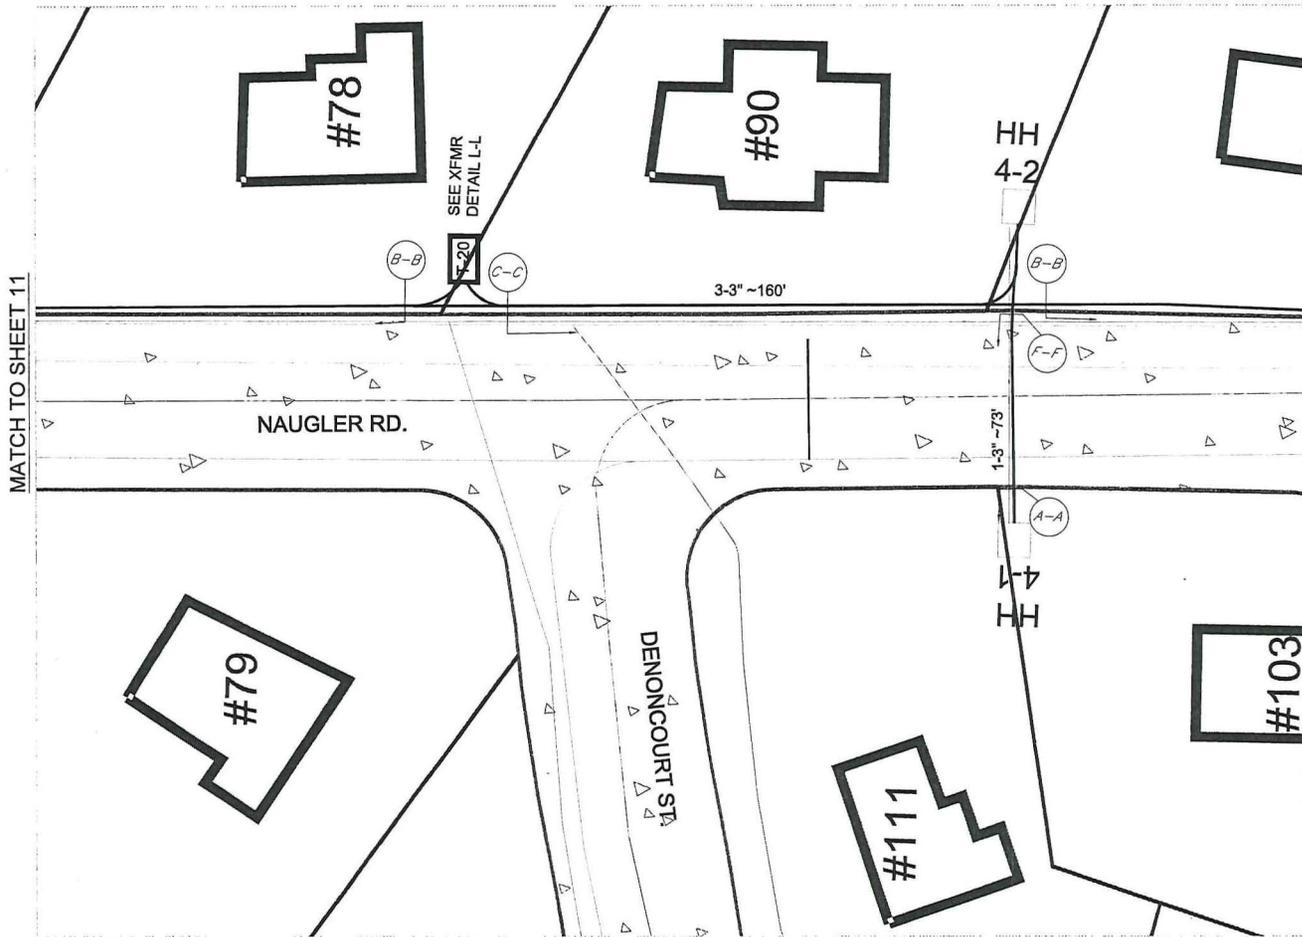

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THIS DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC. IT (I) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.


REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"=10'  
DWG NO: 16508872  
SHT: 12 OF 15  
REV: 0

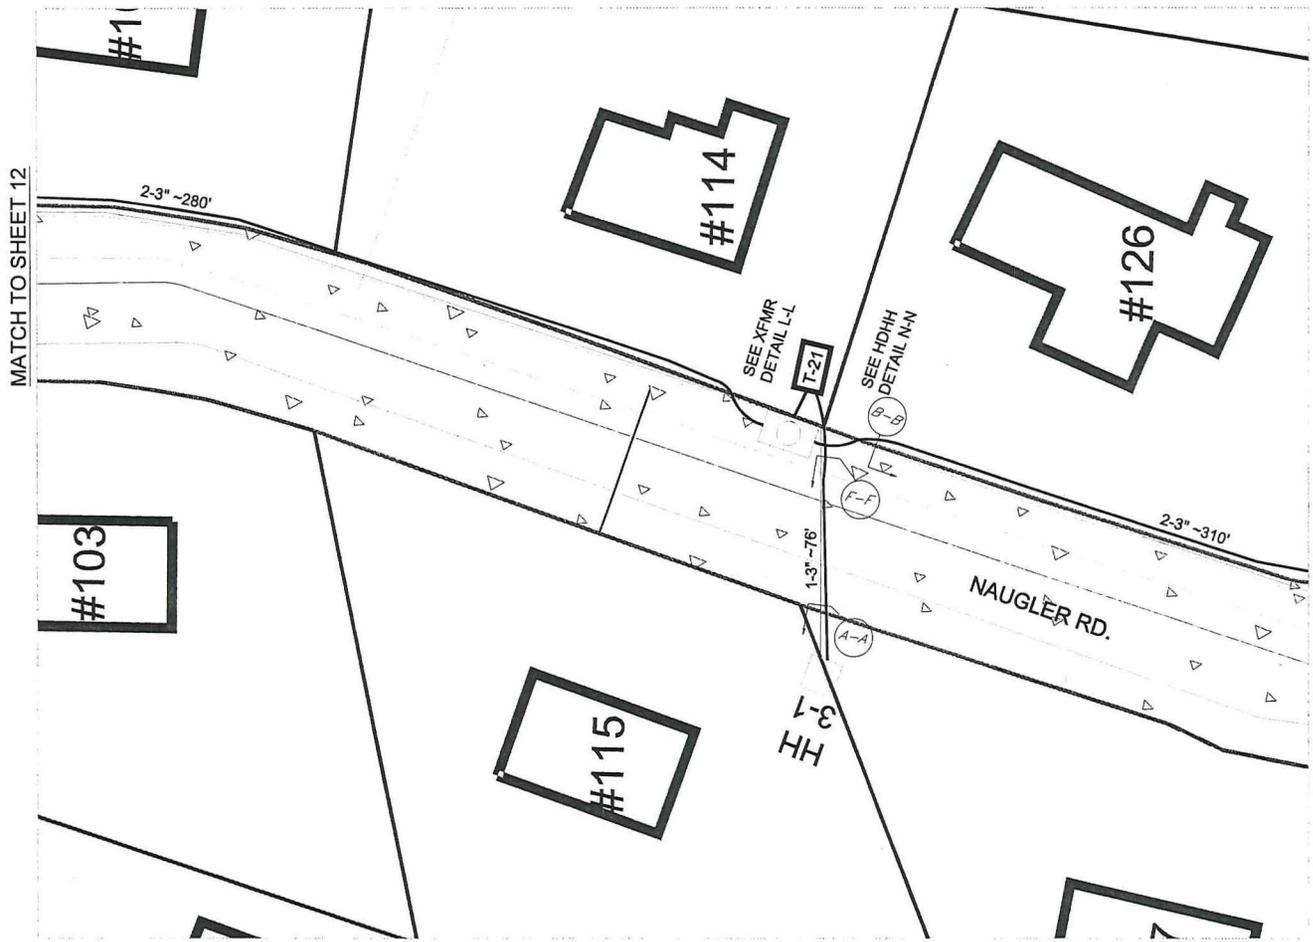

**LEGEND**

	ASPHALT		ELECTRIC
	HYDRANT		SEWER
	TRANSFORMER		DRAIN
	PROPOSED PULL BOX		WATER
	EXISTING HEAVY DUTY HANDHOLE		GAS
	PROPOSED HEAVY DUTY HANDHOLE		PROPOSED ELECTRIC CONDUIT
	REPLACE SECONDARY HANDHOLE		

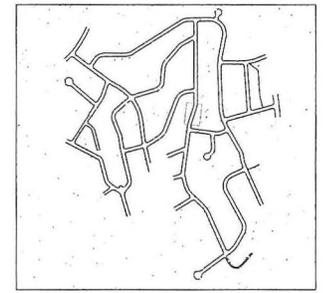

PROPRIETARY NOTICE					
REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

**ControlPoint**  
TECHNOLOGIES


200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**



MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"-10'    DWG NO: 16508872    SHIT: 13 OF 15    REV: 0

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL, TRADE SECRET INFORMATION THEREIN, OR NOT COPY, THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL, TRADE SECRET INFORMATION THEREIN, AND (2) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC., ALL RIGHTS RESERVED.

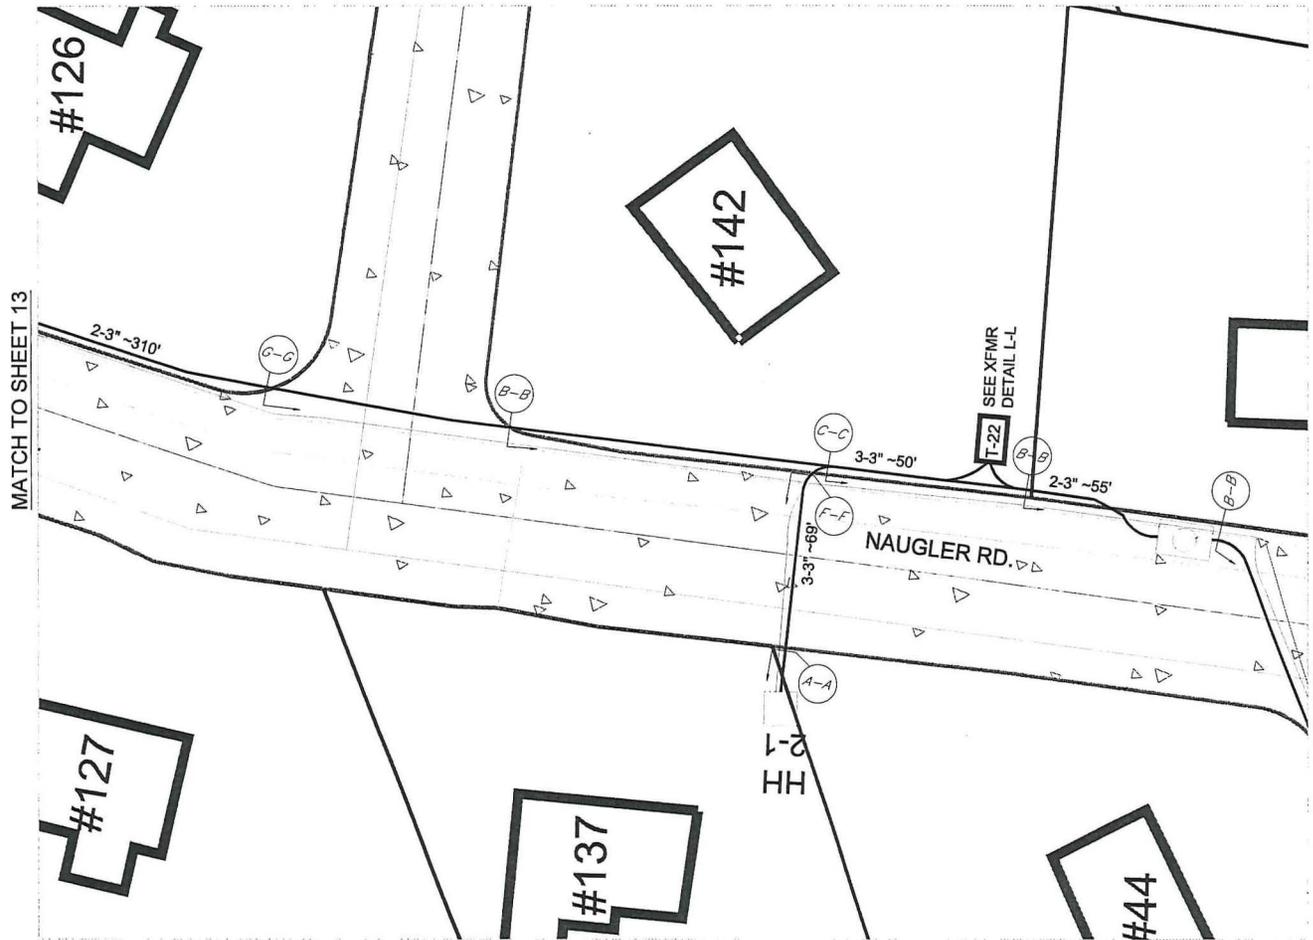

LEGEND	
	ASPHALT
	HYDRANT
	TRANSFORMER
	PROPOSED PULL BOX
	EXISTING HEAVY DUTY HANDHOLE
	PROPOSED HEAVY DUTY HANDHOLE
	REPLACE SECONDARY HANDHOLE
	ELECTRIC
	SEWER
	DRAIN
	WATER
	GAS
	PROPOSED ELECTRIC CONDUIT

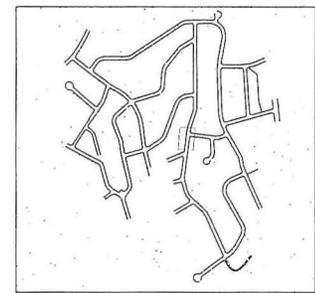

**PROPRIETARY NOTICE**

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETURN OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (I) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY, THE DOCUMENT, OR DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETURN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS


**ControlPoint**  
TECHNOLOGIES

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3082  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON



**nationalgrid**

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: 1"-10'    DWG NO: 16508872    SH: 14 OF 15    REV: 0

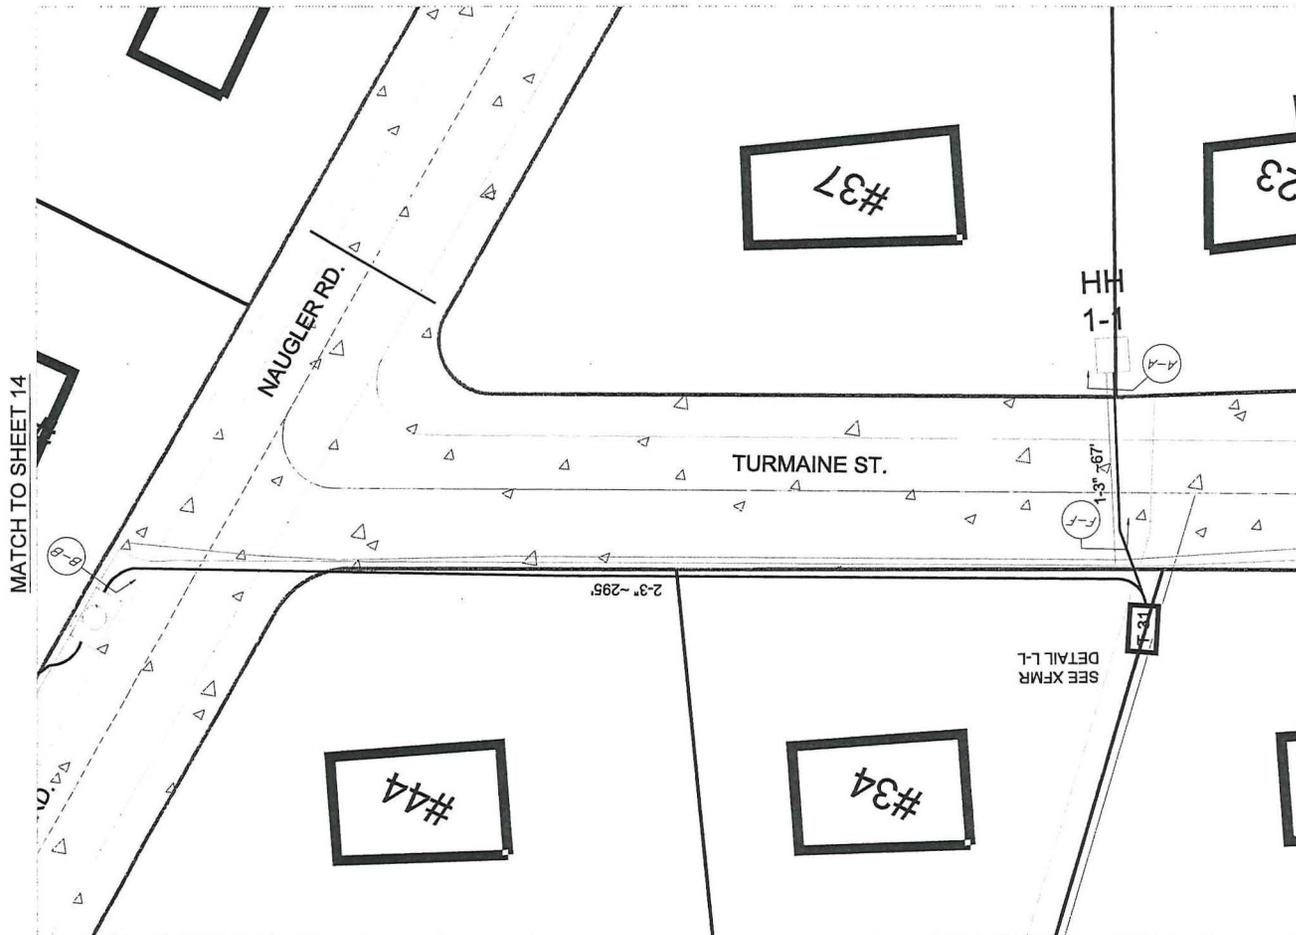

LEGEND	
	ASPHALT
	HYDRANT
	TRANSFORMER
	PROPOSED PULL BOX
	EXISTING HEAVY DUTY HANDHOLE
	PROPOSED HEAVY DUTY HANDHOLE
	REPLACE SECONDARY HANDHOLE
	ELECTRIC
	SEWER
	DRAIN
	WATER
	GAS
	PROPOSED ELECTRIC CONDUIT

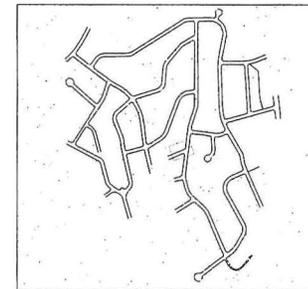

PROPRIETARY NOTICE

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIVING AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT IF AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THIS DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS




200 LEDGEWOOD PLACE SUITE 300  
 ROCKLAND, MA 02370  
 Tel: (781) 423-3062  
 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
 DESIGN ENGINEER: PATRICK SCANLON



MILES STANDISH URD - WR #16508872  
 MARLBOROUGH, MA

SCALE: 1"=10'	DWG NO: 16508872	SHT: 15 OF 15	REV: 0
---------------	------------------	---------------	--------

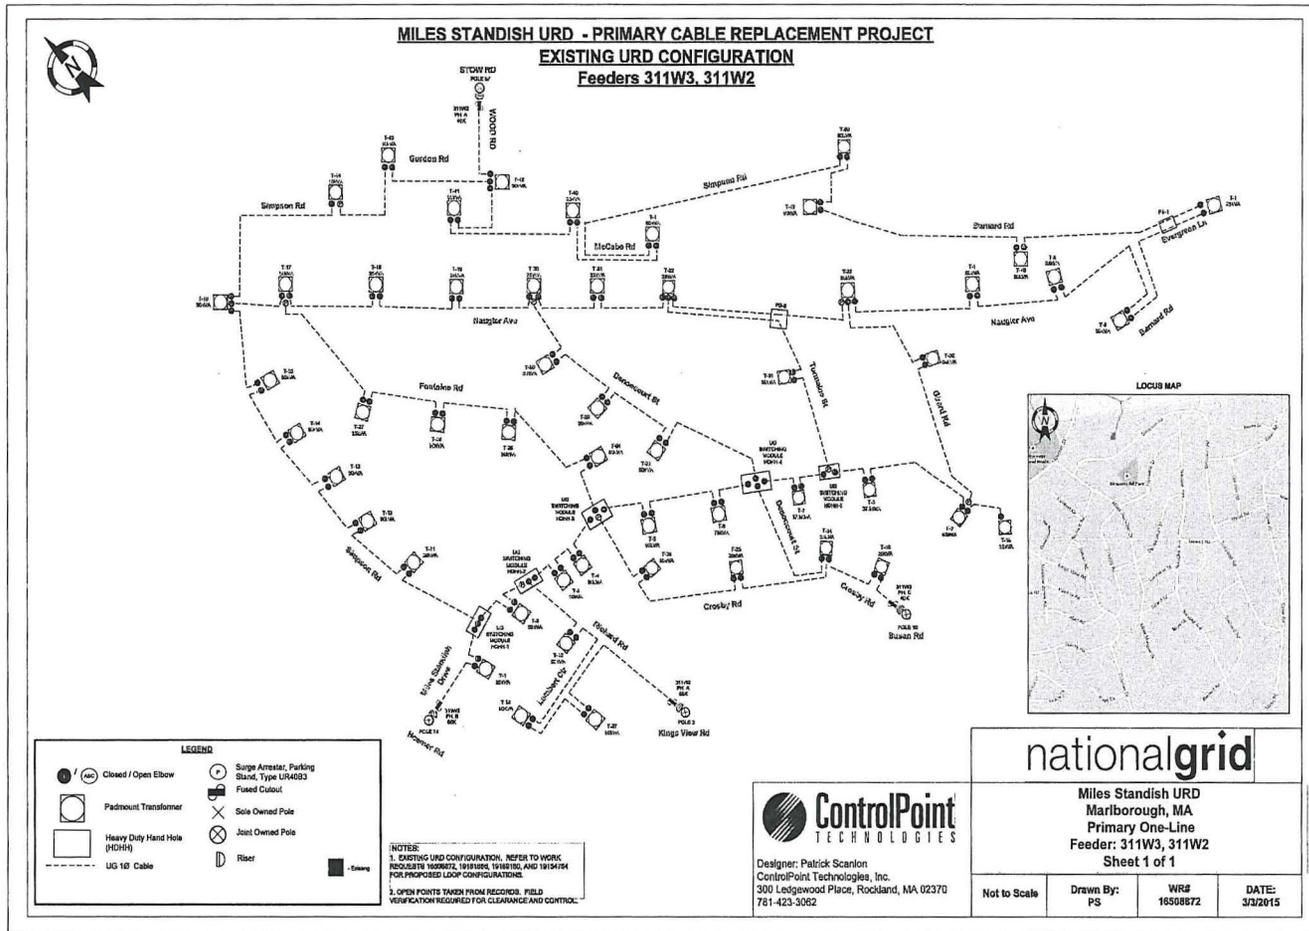

FOR CIVIL CONTRACTOR REFERENCE. ELECTRICAL WORK BY OTHERS.

PROPRIETARY NOTICE					
THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS GIVEN TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THIS DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN; (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.					
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS
REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED


**ControlPoint TECHNOLOGIES**

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
Tel: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: N.T.S	DWG NO: 16508872	SHT: EXISTING OL	REV: 0
--------------	------------------	------------------	--------

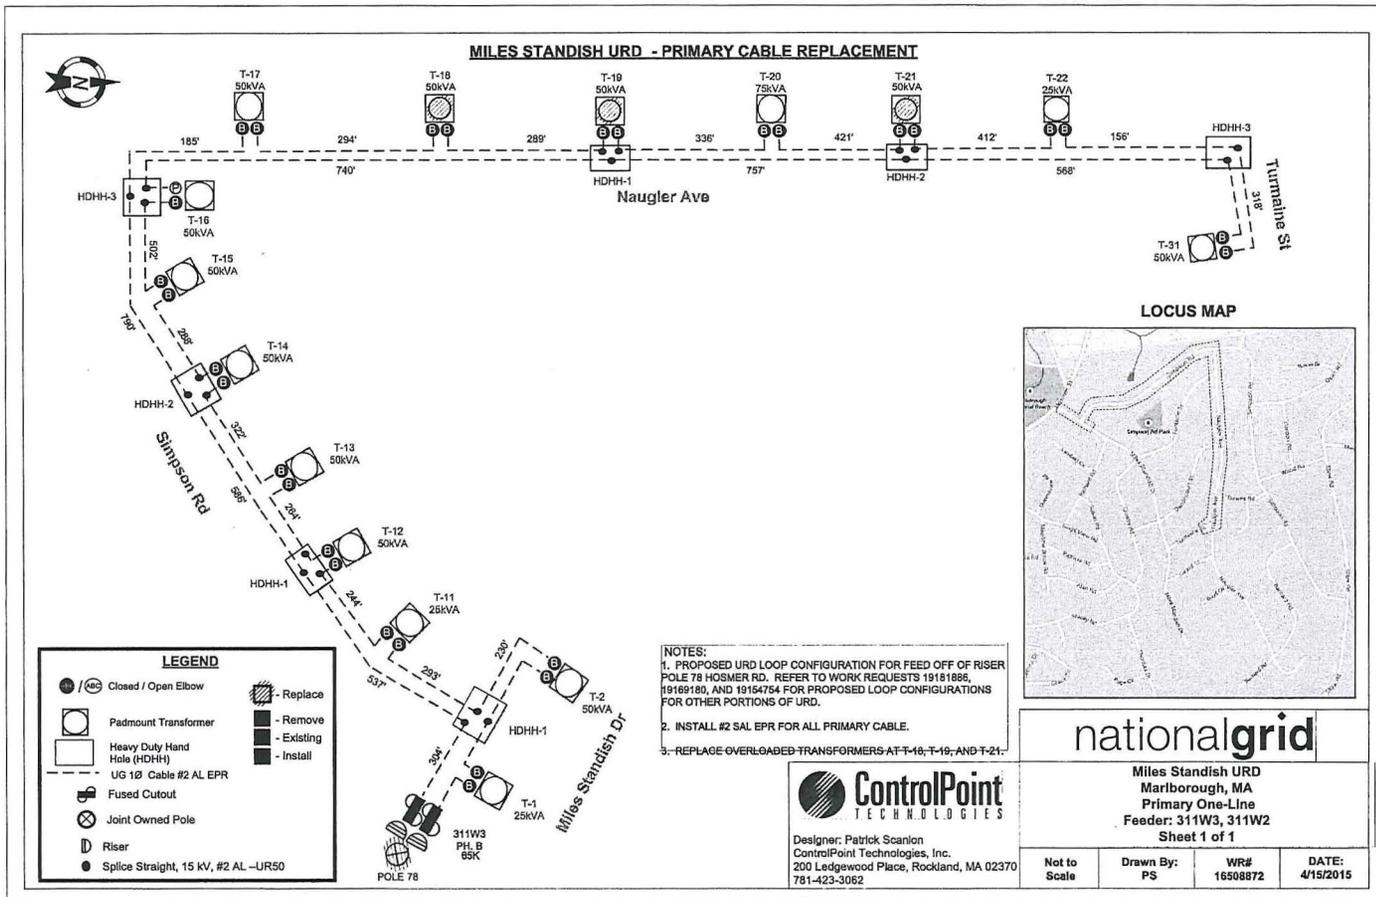

FOR CIVIL CONTRACTOR REFERENCE. ELECTRICAL WORK BY OTHERS.

PROPRIETARY NOTICE					
THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIPT AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT (1) NOT USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS, EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.					
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS
REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED







**ControlPoint**  
TECHNOLOGIES

200 LEDGEWOOD PLACE SUITE 300  
ROCKLAND, MA 02370  
TEL: (781) 423-3062  
E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
DESIGN ENGINEER: PATRICK SCANLON

**nationalgrid**

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: N.T.S.	DWG NO: 16508872	SWF: PROPOSED OL	REV: 0
---------------	------------------	------------------	--------

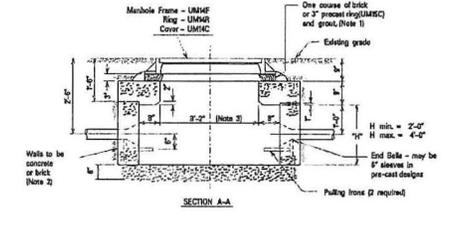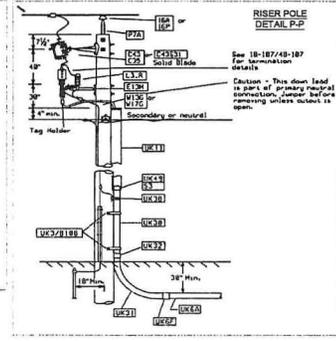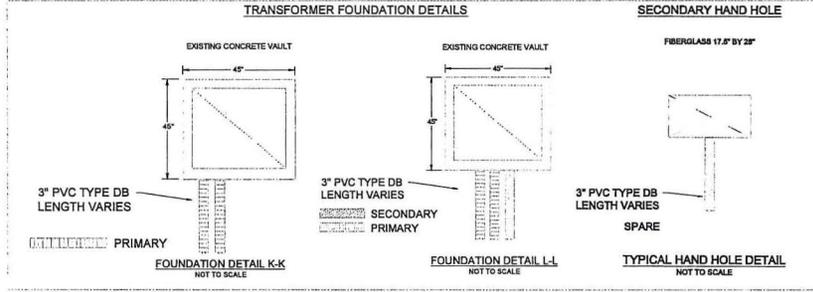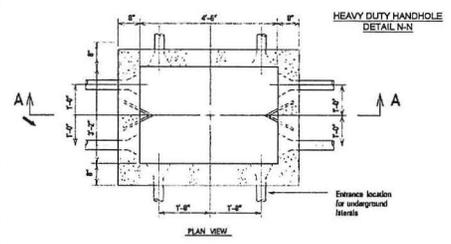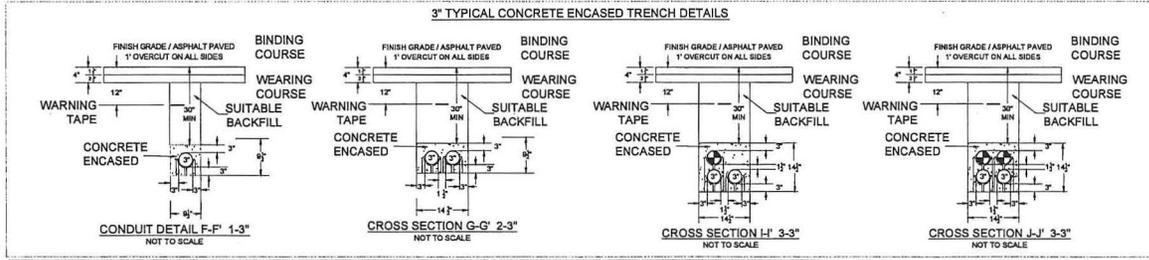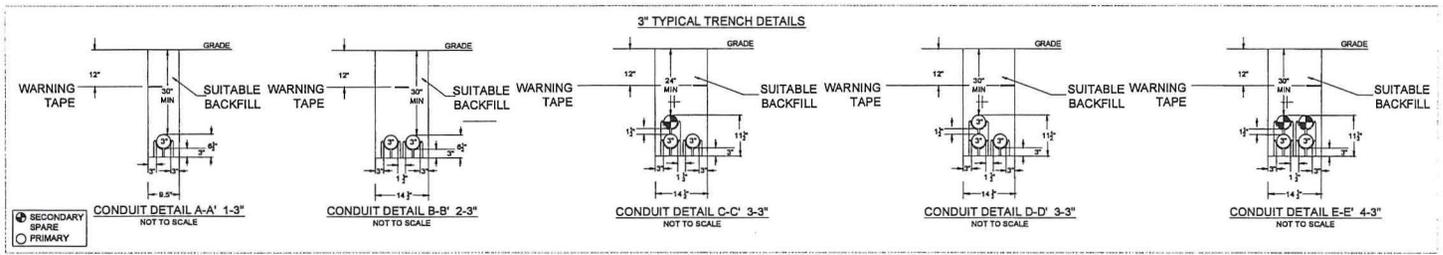

PROPRIETARY NOTICE

THIS DOCUMENT WHICH CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION, IS THE PROPERTY OF CONTROLPOINT TECHNOLOGIES, INC. AND IS LOANED TO THE RECEIVER IN CONFIDENCE. THE RECEIVER, BY RECEIVING AND RETENTION OF THE DOCUMENT, ACCEPTS THE DOCUMENT IN CONFIDENCE, AND AGREES THAT, EXCEPT AS AUTHORIZED IN WRITING BY CONTROLPOINT TECHNOLOGIES, INC., IT IS NOT TO USE THE DOCUMENT OR ANY COPY THEREOF, OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, (2) NOT COPY THE DOCUMENT, (3) DISCLOSE TO OTHERS EITHER THE DOCUMENT OR THE CONFIDENTIAL TRADE SECRET INFORMATION THEREIN, AND (4) UPON COMPLETION OF THE NEED TO RETAIN THE DOCUMENT, OR UPON DEMAND, RETURN THE DOCUMENT, ALL COPIES THEREOF, AND ALL MATERIAL COPIED THEREFROM. COPYRIGHT © CONTROLPOINT TECHNOLOGIES, INC. ALL RIGHTS RESERVED.

REV	DESCRIPTION	DATE	CADD	ENGINEER	APPROVED
0	INITIAL RELEASE	4/15/2015	JPP	PS	PS

200 LEDGEWOOD PLACE SUITE 300  
 ROCKLAND, MA 02370  
 Tel: (781) 423-3022  
 E-MAIL: PSCANLON@CONTROLPOINTTECH.COM  
 DESIGN ENGINEER: PATRICK SCANLON

# nationalgrid

MILES STANDISH URD - WR #16508872  
MARLBOROUGH, MA

SCALE: N.T.S.    DWG NO: 16508872    SHF: DETAILS    REV: 0



## IN CITY COUNCIL

Marlborough, Mass.,

JULY 27, 2015

PAGE 1

### ORDERED:

That the **PUBLIC HEARING** On the Petition of NGrid to install 3" conduit and install new #2 AL cable throughout Miles Standish residential development along the route of the existing cable due to numerous cable failures, Order No. 15-1006263, all were heard who wish to be heard, hearing recessed at 8:40 PM.

**Councilors Present:** Ossing, Robey, Delano, Elder, Tunnera, Irish, Clancy & Landers.

**Absent:** Oram & Page

Jack Saraiva spoke on behalf of the petition of National Grid to install about 16,000 feet of conduit and cable in the Miles Standish area. Pat Scanlon, the design engineer for the project was also present.

There is no one else speaking in favor. That part of the Public Hearing is closed.

### QUESTIONS FROM THE PUBLIC

Charlene Bencivenga of Denoncourt Street had several questions for the petitioner:

When will the work start and stop?

How can residents obtain status updates?

What kind of outages can residents expect during the work?

Mr. Saraiva explained the contract will be awarded at the end of August and they are asking the contractor to begin as soon as possible, as early as September. They plan on working as long as they can through the winter, weather permitting.

During this portion of the work, there should not be any outages as they are just installing the conduit. There will be short outages during the transfer from the old cable to the new cable. They have a notification process in place and residents will be notified seven days before any outage. Ms. Bencivenga asked for a definition of a short outage. Mr. Saraiva indicated it would be minutes as they unplug the old transformer and plug in the new cable.

Ms. Bencivenga wanted to know how they could obtain project status. Mr. Saraiva offered to provide his contact information with her and Councilor Landers stated he can be found driving the neighborhoods in his ward.



## IN CITY COUNCIL

Marlborough, Mass., \_\_\_\_\_ JULY 27, 2015  
PAGE 2

### ORDERED:

Karen Manning of Crosby Road asked what effect this work would have on her property on Crosby Road. She is constantly plagued with power outages and has replaced two controller boards on appliances at her residence. She did not know if the work would come her way or help improve the situation at her property. Mr. Saraiva explained the work in the Crosby Road area will be next year. They are trying to make the system more reliable and have simplified and reconfigured the circuits in the area so that outage times are minimal.

Ms. Manning confirmed by this time next year, her property will be included in the system upgrades. Mr. Saraiva stated that it is too far in the future to provide an exact time frame but he estimated work would start in spring of 2016. Ms. Manning asked when plans for her street would be completed. Mr. Saraiva indicated the plans are complete but they are only doing half the work this year. The feed comes from two directions, Stow Road and Richards Road, and Crosby Road is not on either of those circuits.

Marie Subrizio of Fontaine Street assumed they have to dig up all the underground area in order to run the new conduit and then run the cable through it. Mr. Saraiva confirmed her assumption. Ms. Subrizio asked if Fontaine Street is included in National Grid's plan. Mr. Saraiva confirmed Fontaine Street is in their plan. Ms. Subrizio asked when he expects to reach Fontaine Street. Mr. Saraiva could not provide an exact time frame as the civil group will determine the order of work as they move throughout the targeted area, but he estimated it could be anywhere from mid to late fall of this year.

Ms. Subrizio asked if they are just running the conduit. Mr. Saraiva indicated just conduit as it would be difficult to say whether the cable is installed by that point. Ms. Subrizio specified to prevent the power from going down, they need the cable installed not just the conduit. Mr. Saraiva stated the conduit will be installed and another group will install the cable which is not yet scheduled. He is unsure of when that will happen.

Ms. Subrizio confirmed they will stop work in the winter. Mr. Saraiva explained once winter begins and the ground is frozen, they will stop at that point and if the work is not complete they will return in the spring. She verified the interruptions to service will be brief. Mr. Saraiva confirmed and explained the current cable is installed in dirt but the new cable will be installed in conduit which is easier to repair.

Ms. Subrizio detailed how this has been ongoing for at least the past five to seven years and she has been in contact with many officials regarding the problem. Mr. Saraiva apologized for the problems and they are managing the project now and going through the Miles Standish development and look to finish by the end of next year.



## IN CITY COUNCIL

Marlborough, Mass.,

JULY 27, 2015

PAGE 3

### ORDERED:

There are no further questions from the public. That part of the Public Hearing is closed.

### PUBLIC SPEAKING IN OPPOSITION

There is no one speaking in opposition. That part of the Public Hearing is closed.

### QUESTIONS FROM THE CITY COUNCIL

✓ Councilor Landers has lived in the neighborhood for forty-seven years and is glad to hear they are using conduit. He asked as it comes closer to the winter, can they install cable in conduit already in place especially in some areas like Fontaine and part of Simpson that are particularly bad for outages. Mr. Saraiva could not provide a firm answer to that question and will get back to him. Councilor Landers stated there will be a Public Services Committee meeting in the latter part of August and he suggested they look into making the sidewalks compliant with handicap accessibility and to bring that information to their meeting.

✓ Councilor Robey stated a member of the audience asked about Fontaine Street, but the information received by the Councilors only covers Miles Standish, Simpson, Naugler, and Turmaine Streets. Councilor Landers commented that Councilor Robey has a different copy and Mr. Saraiva stated there are two different sets of drawings.

✓ Councilor Ossing suggested to the petitioner when they appear before the Public Services Committee they have the information for what streets are being done and when do they plan on performing the work. They should bring a best estimation of their schedule of the work for all streets in the project.

There are no further questions from members of City Council. That part of the Public Hearing is closed.

ADOPTED

ORDER NO. 15-1006263A



## IN CITY COUNCIL

Marlborough, Mass., JULY 13, 2015

### ORDERED:

That there being no objection thereto set **MONDAY, JULY 27, 2015** as date for a **PUBLIC HEARING** On the Petition of Eversource Energy to install 1200' of 6" IP plastic gas main as a system improvement on Ames St. from Nickerson Rd. running Northwesterly to Reilly Way, be and is herewith refer to **PUBLIC SERVICES COMMITTEE.**

ADOPTED

ORDER NO. 15-1006264



**City of Marlborough, Massachusetts  
CITY CLERK DEPARTMENT**

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 JUL 14 P 12:46

**Lisa M. Thomas  
City Clerk**

**CITY OF MARLBOROUGH  
OFFICE OF THE CITY CLERK  
NOTICE OF PUBLIC HEARING**

Notice is hereby given that the City Council of the City of Marlborough will hold a **PUBLIC HEARING** in City Council Chambers, City Hall on **Monday, July 27, 2015** at **8:00 p.m.** on the Petition of Eversource to install 1200' of 6" IP plastic gas main as a system improvement on Ames St. from Nickerson Rd. running Northwesterly to Reilly Way.

Per Order of City Council  
15-1006264

**EVERSOURCE**  
Energy

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH  
2015 JUN 19 A 10:01

157 Cordaville Road  
Southborough, MA 01772

June 18, 2015

Ms. Lisa M. Thomas  
City Clerk  
City Hall  
140 Main Street  
Marlborough, MA 01752

Marlborough City Council:

Please approve for Grant purposes the following plan:

**To install 1200' of 6" IP plastic gas main as a system improvement on Ames St from  
Nickerson Rd running NW'rly to Reilly Way**


Respectfully,



Christopher Howard  
Planning & Scheduling Supervisor

TYPICAL TRENCH DETAIL

NOT TO SCALE

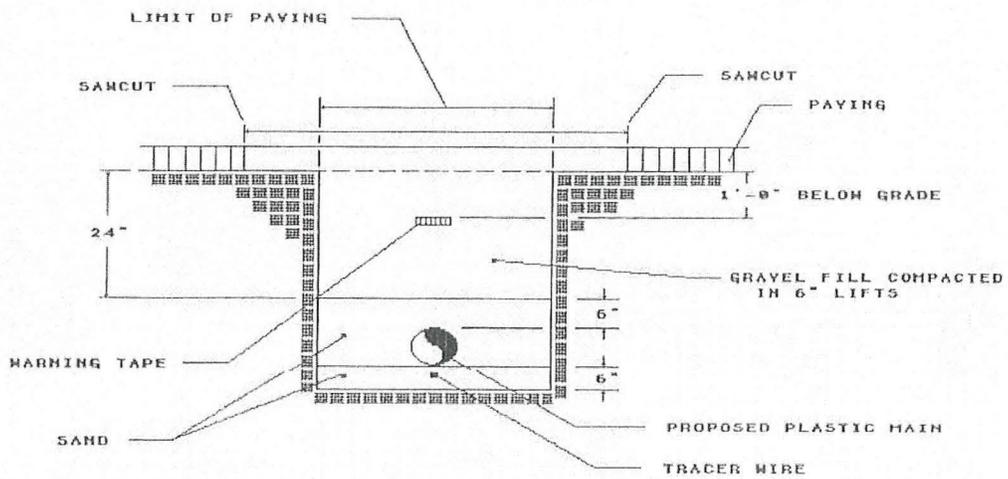



## IN CITY COUNCIL

Marlborough, Mass., \_\_\_\_\_ JULY 27, 2015

### ORDERED:

That the **PUBLIC HEARING** On the Petition of Eversource Energy to install 1200' of 6" IP plastic gas main as a system improvement on Ames St. from Nickerson Rd. running Northwesterly to Reilly Way, Order No. 15-1006264, all were heard who wish to be heard, hearing recessed at 8:25 PM.

**Councilors Present: Ossing, Robey, Delano, Elder, Tunnera, Irish, Clancy & Landers.**

**Absent: Oram & Page**

JoAnne O'Leary, Community Relations Representative for Eversource Energy, appeared before the City Council to request permission to install 1200 feet of six inch intermediate pressure plastic gas main as a system improvement on Ames Street from Nickerson Road running northwesterly to Reilly Way and 155 Ames Street in Marlborough.

There is no one else speaking in favor. That part of the Public Hearing is closed.

### QUESTIONS FROM THE PUBLIC

There are no questions from the public. That part of the Public Hearing is closed.

### PUBLIC SPEAKING IN OPPOSITION

There is no one speaking in opposition. That part of the Public Hearing is closed.

### QUESTIONS FROM THE CITY COUNCIL

✓ Councilor Landers asked the timetable for this project. Ms. O'Leary replied the project would take three weeks to complete.

✓ Councilor Landers asked when they hope to start the project. Ms. O'Leary responded because of the City Council schedule, they are looking at late fall. As soon as they receive permission to proceed, they will put it on their schedule and the job itself will last three weeks. Councilor Landers indicated the petition will go to the Public Services committee and there will be a meeting during the third week of August so it can be acted upon at the August 24<sup>th</sup> City Council meeting.

There are no further questions from members of City Council. That part of the Public Hearing is closed.

That ends the entire Public Hearing. This is currently in the Public Services Committee.

ADOPTED

ORDER NO. 15-1006264A



# IN CITY COUNCIL

Marlborough, Mass., JUNE 1, 2015

## ORDERED:

That there being no objection thereto set **MONDAY, JUNE 15, 2015** as date for a **PUBLIC HEARING** On the Petition of Eversource to install 160' of 2" IP plastic gas main as a system improvement to 7 Corey Rd., be and is herewith refer to **PUBLIC SERVICES COMMITTEE.**

ADOPTED

ORDER NO. 15-1006237



**City of Marlborough, Massachusetts**

**CITY CLERK DEPARTMENT**

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 JUN -3 A 9:47

**Lisa M. Thomas**  
**City Clerk**

**CITY OF MARLBOROUGH  
OFFICE OF THE CITY CLERK  
NOTICE OF PUBLIC HEARING**

Notice is hereby given that the City Council of the City of Marlborough will hold a PUBLIC HEARING in City Council Chambers, City Hall on **Monday, June 15, 2015 at 8:00 p.m.** on the Petition of Eversource to install 160' of 2" IP plastic gas main as a system improvement to 7 Corey Road.

Per Order of City Council  
15-1006237

EVERSOURCE  
ENERGY

RECEIVED  
CITY CLERK'S OFFICE  
CITY OF MARLBOROUGH

2015 MAY 21 A 11: 35

157 Cordaville Road  
Southborough, MA 01772

May 15, 2015

Ms. Lisa M. Thomas  
City Clerk  
City Hall  
140 Main Street  
Marlborough, MA 01752

Marlborough City Council:

Please approve for Grant purposes the following plan:


To install 160' of 2" IP plastic gas main as a system improvement to 7 Corey Road.

Corey Road – 160' from the intersection with Hildreth Street southerly to #7 Corey Road

Respectfully,



Christopher Howard  
Supervisor Planning and Scheduling  
Eversource Gas

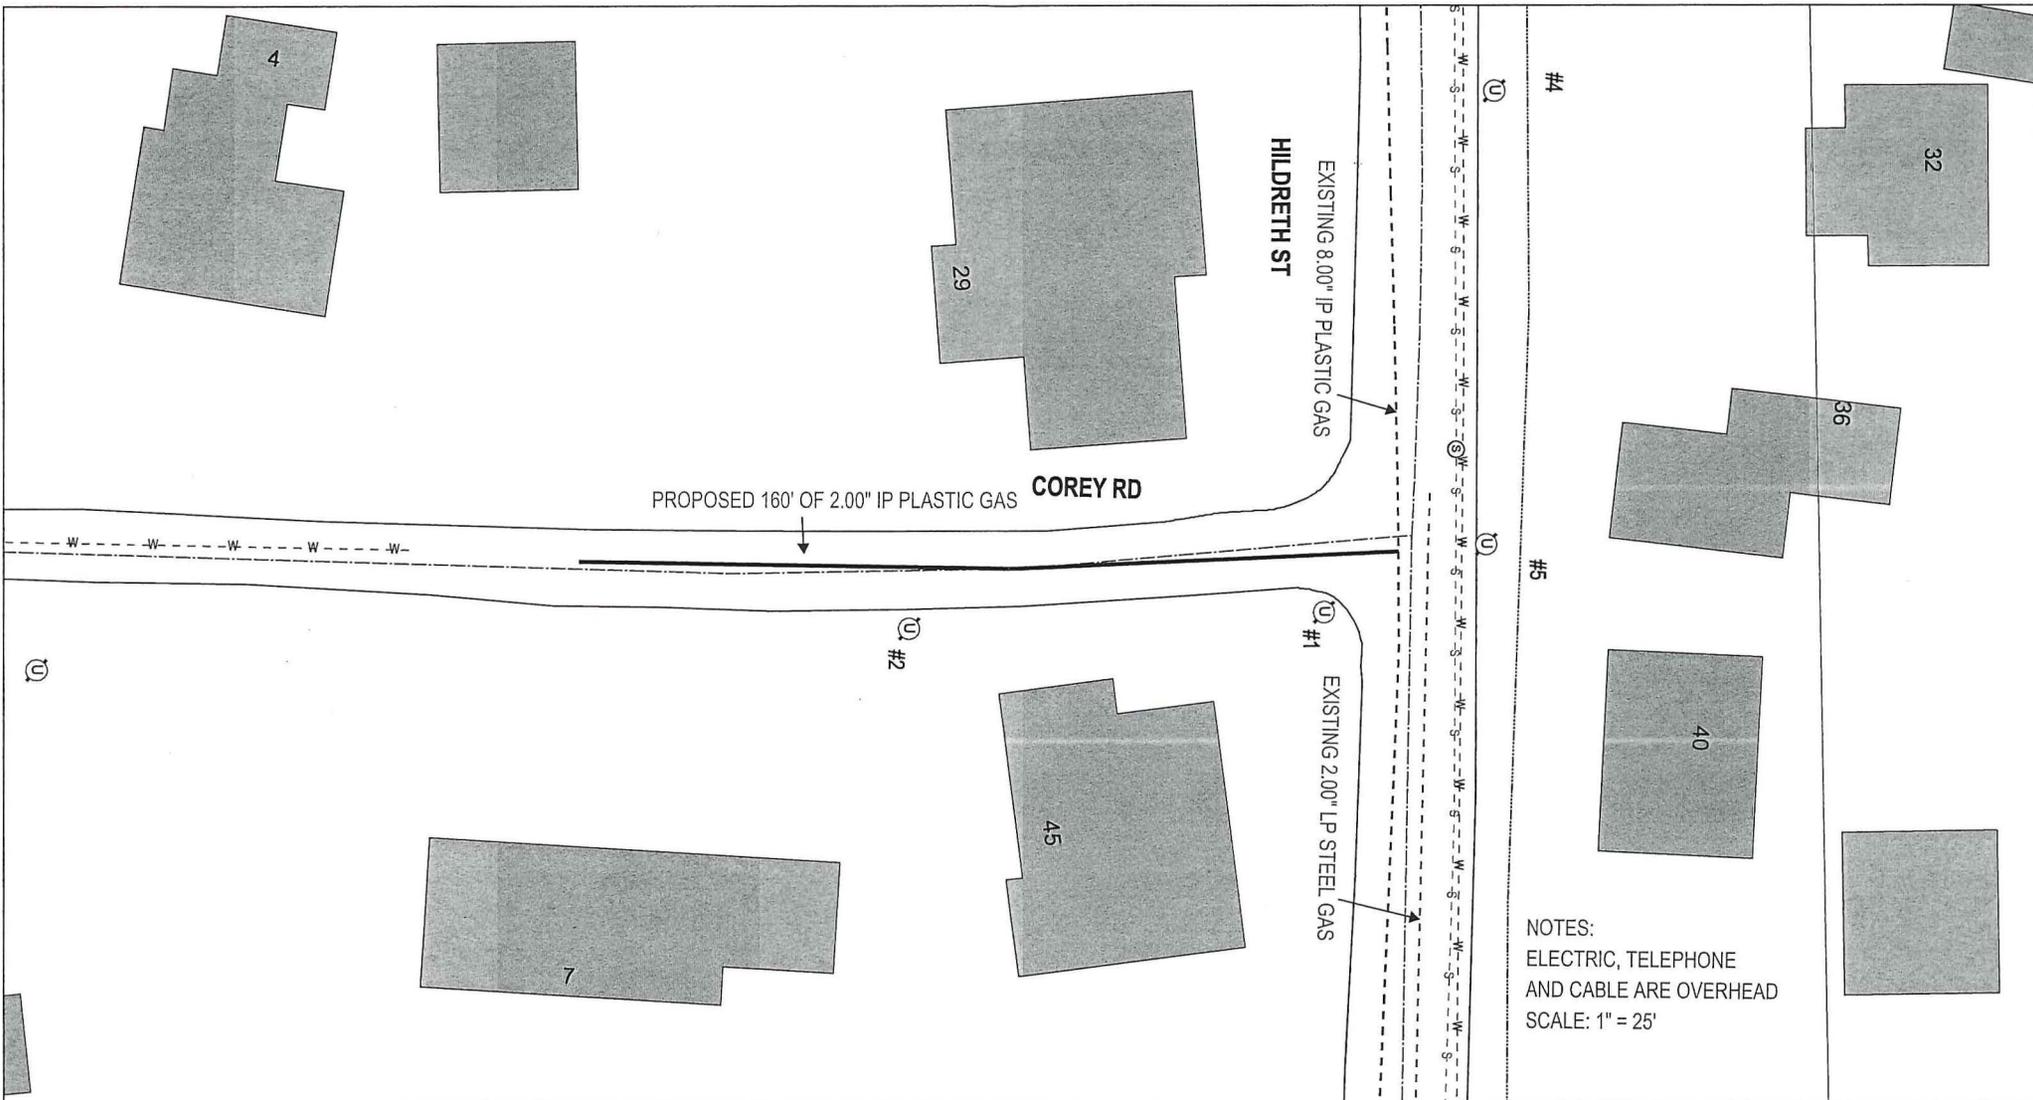

NOTES:  
 ELECTRIC, TELEPHONE  
 AND CABLE ARE OVERHEAD  
 SCALE: 1" = 25'

**MASS LAW**

Requires 72 hours advance notice to Utility Companies before digging by Anyone

Call Dig-Safe 1-811

**IMPORTANT - DO NOT SCALE**

This drawing provides approximate locations only and all facility information may not be shown. Contact NSTAR Gas to have specific field information identified. NSTAR Gas declines any liability resulting from reliance by any on the location shown on this map. Massachusetts law requires that any person performing excavation work contact Dig-Safe so that the location of any underground may be marked.

Address: COREY ROAD, MARLBORO

City / Town: GRANT PLAN - SHEET 1 OF 1

